

**DeKalb County School District/Admin/Support**

# **Doraville Administration**

**Final**

## **School Assessment Report**

**May 19, 2016**



## Table of Contents

School Executive Summary	4
School Condition Summary	5
<b><u>1951, 1977 Building</u></b>	7
Executive Summary	7
Condition Summary	8
Photo Album	9
Condition Detail	10
System Listing	11
Renewal Schedule	13
Forecasted Sustainment Requirement	16
Deficiency Summary By System	17
Deficiency Summary By Priority	18
Deficiency By Priority Investment	19
Deficiency Summary By Category	20
Deficiency Details By Priority	21
<b><u>1977 Pump House</u></b>	31
Executive Summary	31
Condition Summary	32
Photo Album	33
Condition Detail	34
System Listing	35
Renewal Schedule	36
Forecasted Sustainment Requirement	39
Deficiency Summary By System	40
Deficiency Summary By Priority	41
Deficiency By Priority Investment	42
Deficiency Summary By Category	43
Deficiency Details By Priority	44
<b><u>Site</u></b>	47

## School Assessment Report

---

Executive Summary	47
Condition Summary	48
Photo Album	49
Condition Detail	50
System Listing	51
Renewal Schedule	52
Forecasted Sustainment Requirement	54
Deficiency Summary By System	55
Deficiency Summary By Priority	56
Deficiency By Priority Investment	57
Deficiency Summary By Category	58
Deficiency Details By Priority	59
Glossary	65

## School Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Gross Area (SF):	5,645
Year Built:	1951
Last Renovation:	
Replacement Value:	\$1,595,845
Repair Cost:	\$1,406,223.58
Total FCI:	88.12 %
Total RSLI:	4.81 %
FCA Score:	11.88



### Description:

The Doraville Administration campus, formerly known as Doraville Drivers Education, consists of two buildings located at 3932 Flowers Road in Atlanta, Georgia. The original campus was constructed in 1951 and an addition was constructed in 1977. In addition to the buildings, the campus contains a pump house. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report for each building and site improvement on the campus.

### Attributes:

#### General Attributes:

Assigned Region:	Region 1	Board District:	District 1
DOE Facility:	9006	Geographic Region:	Region 1
HS Attendance Area:	Dunwoody HS	Jurisdictional City:	City of Doraville
Site Acreage:	3.3		

## School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.


### Current Investment Requirement and Condition by Unifomat Classification

UNIFORMAT Classification	RSLI%	FCI %	Current Repair
A10 - Foundations	36.30 %	0.00 %	\$0.00
A20 - Basement Construction	0.00 %	0.00 %	\$0.00
B10 - Superstructure	34.53 %	4.09 %	\$1,712.58
B20 - Exterior Enclosure	0.86 %	18.83 %	\$31,093.29
B30 - Roofing	0.00 %	110.00 %	\$128,537.00
C10 - Interior Construction	13.04 %	70.16 %	\$61,117.00
C20 - Stairs	5.00 %	0.00 %	\$0.00
C30 - Interior Finishes	28.81 %	75.73 %	\$95,084.00
D10 - Conveying	0.00 %	0.00 %	\$0.00
D20 - Plumbing	0.00 %	110.00 %	\$79,965.00
D30 - HVAC	0.00 %	110.00 %	\$116,928.00
D40 - Fire Protection	0.00 %	0.00 %	\$0.00
D50 - Electrical	0.01 %	109.76 %	\$155,090.00
E10 - Equipment	0.00 %	0.00 %	\$0.00
E20 - Furnishings	0.00 %	0.00 %	\$0.00
G20 - Site Improvements	0.00 %	110.00 %	\$673,297.69
G30 - Site Mechanical Utilities	0.00 %	110.00 %	\$40,548.05
G40 - Site Electrical Utilities	0.00 %	110.00 %	\$22,850.97
<b>Totals:</b>	<b>4.81 %</b>	<b>88.12 %</b>	<b>\$1,406,223.58</b>

### Condition Deficiency Priority

Facility Name	Gross Area (S.F.)	FCI %	1 Priority	2 Priority	3 Priority	4 Priority	5 Priority
1951, 1977 Building	5,545	72.40	\$0.00	\$126,260.00	\$537,137.00	\$0.00	\$0.00
1977 Pump House	100	62.58	\$0.00	\$0.00	\$6,129.87	\$0.00	\$0.00
Site	5,645	110.00	\$0.00	\$9,003.78	\$727,692.93	\$0.00	\$0.00
<b>Total:</b>		<b>88.12</b>	<b>\$0.00</b>	<b>\$135,263.78</b>	<b>\$1,270,959.80</b>	<b>\$0.00</b>	<b>\$0.00</b>

### Deficiencies By Priority

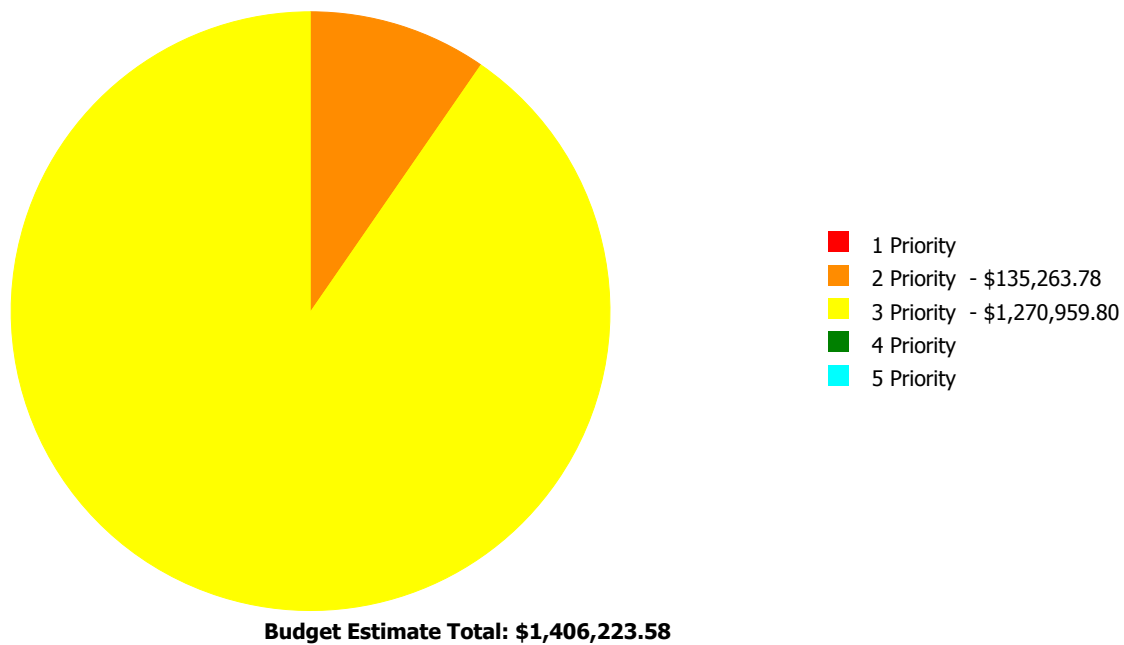

## Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Function:	Admin/Support
Gross Area (SF):	5,545
Year Built:	1951
Last Renovation:	
Replacement Value:	\$916,325
Repair Cost:	\$663,397.00
Total FCI:	72.40 %
Total RSLI:	8.20 %
FCA Score:	27.60



### Description:

The main building at Doraville Administration is a one-story building located at 3932 Flowers Road in Atlanta, Georgia. Originally built in 1951, there has been one addition in 1977 (an observation room on the second floor which is accessible from the exterior) and no major renovations. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report.

### Attributes:

#### General Attributes:

Building Codes:	8010, 8011	Fire Sprinkler System:	No
-----------------	------------	------------------------	----



## Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	36.00 %	0.00 %	\$0.00
A20 - Basement Construction	0.00 %	0.00 %	\$0.00
B10 - Superstructure	36.00 %	0.00 %	\$0.00
B20 - Exterior Enclosure	0.00 %	18.83 %	\$30,336.00
B30 - Roofing	0.00 %	110.00 %	\$126,260.00
C10 - Interior Construction	13.04 %	70.16 %	\$61,117.00
C20 - Stairs	5.00 %	0.00 %	\$0.00
C30 - Interior Finishes	28.81 %	75.73 %	\$95,084.00
D10 - Conveying	0.00 %	0.00 %	\$0.00
D20 - Plumbing	0.00 %	110.00 %	\$79,965.00
D30 - HVAC	0.00 %	110.00 %	\$116,928.00
D40 - Fire Protection	0.00 %	0.00 %	\$0.00
D50 - Electrical	0.00 %	110.00 %	\$153,707.00
E10 - Equipment	0.00 %	0.00 %	\$0.00
E20 - Furnishings	0.00 %	0.00 %	\$0.00
<b>Totals:</b>	<b>8.20 %</b>	<b>72.40 %</b>	<b>\$663,397.00</b>



### Photo Album

The photo album consists of the various cardinal directions of the building.

1). South Elevation - May 04, 2015



2). East Elevation - May 04, 2015



3). North Elevation - May 04, 2015



4). Northwest Elevation - May 04, 2015



### Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system.
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment).
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system.

## School Assessment Report - 1951, 1977 Building

### System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$3.26	S.F.	5,545	100	1951	2051		36.00 %	0.00 %	36			\$18,077
A1020	Special Foundations	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
A1030	Slab on Grade	\$2.36	S.F.	5,545	100	1951	2051		36.00 %	0.00 %	36			\$13,086
A2010	Basement Excavation	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
A2020	Basement Walls	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
B1010	Floor Construction	\$4.10	S.F.	5,545	100	1951	2051		36.00 %	0.00 %	36			\$22,735
B1020	Roof Construction	\$3.15	S.F.	5,545	100	1951	2051		36.00 %	0.00 %	36			\$17,467
B2010	Exterior Walls	\$23.72	S.F.	5,545	60	1951	2011		0.00 %	0.00 %	-4			\$131,527
B2020	Exterior Windows	\$3.92	S.F.	5,545	30	1977	2007		0.00 %	100.00 %	-8		\$21,736.00	\$21,736
B2030	Exterior Doors	\$1.41	S.F.	5,545	30	1977	2007		0.00 %	110.00 %	-8		\$8,600.00	\$7,818
B3010	Roof Coverings - BUR	\$20.70	S.F.	5,545	25	1995	2020	2015	0.00 %	110.00 %	0		\$126,260.00	\$114,782
B3020	Roof Openings	\$0.00	S.F.		0				0.00 %	0.00 %				\$0
C1010	Partitions	\$5.69	S.F.	5,545	100	1951	2051		36.00 %	0.00 %	36			\$31,551
C1020	Interior Doors	\$8.47	S.F.	5,545	30	1977	2007		0.00 %	110.00 %	-8		\$51,663.00	\$46,966
C1030	Fittings	\$1.55	S.F.	5,545	20	1977	1997		0.00 %	109.99 %	-18		\$9,454.00	\$8,595
C2010	Stair Construction	\$6.80	S.F.	5,545	40	1977	2017		5.00 %	0.00 %	2			\$37,706
C3010	Wall Finishes - Ceramic Tile	\$10.27	S.F.	455	30	1951	1981		0.00 %	109.99 %	-34		\$5,140.00	\$4,673
C3010	Wall Finishes - Paint	\$1.93	S.F.	5,090	10	2014	2024		90.00 %	0.00 %	9			\$9,824
C3010	Wall Finishes - Wall Coverings	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C3020	Floor Finishes - Carpet	\$8.50	S.F.	1,575	8	1995	2003		0.00 %	109.99 %	-12		\$14,726.00	\$13,388
C3020	Floor Finishes - Ceramic Tile	\$14.49	S.F.	900	50	1951	2001		0.00 %	110.00 %	-14		\$14,345.00	\$13,041
C3020	Floor Finishes - Terrazzo	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C3020	Floor Finishes - Vinyl Tile	\$9.54	S.F.	3,070	15	2014	2029		93.33 %	0.00 %	14			\$29,288
C3020	Floor Finishes - Wood	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C3030	Ceiling Finishes	\$9.98	S.F.	5,545	20	1995	2015		0.00 %	110.00 %	0		\$60,873.00	\$55,339
D1010	Elevators and Lifts	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D2010	Plumbing Fixtures	\$4.94	S.F.	5,545	30	1951	1981		0.00 %	110.00 %	-34		\$30,132.00	\$27,392
D2020	Domestic Water Distribution	\$3.84	S.F.	5,545	30	1951	1981		0.00 %	110.00 %	-34		\$23,422.00	\$21,293
D2030	Sanitary Waste	\$4.33	S.F.	5,545	30	1951	1981		0.00 %	110.00 %	-34		\$26,411.00	\$24,010
D2040	Rain Water Drainage	\$0.00	S.F.		30				0.00 %	0.00 %				\$0
D2090	Other Plumbing Systems - Natural Gas	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D3020	Heat Generating Systems	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D3030	Cooling Generating Systems	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D3040	Distribution Systems & Exhaust Systems	\$0.65	S.F.	5,545	30	1951	1981		0.00 %	110.02 %	-34		\$3,965.00	\$3,604

# School Assessment Report - 1951, 1977 Building

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
D3050	Terminal & Package Units	\$18.52	S.F.	5,545	15	1977	1992		0.00 %	110.00 %	-23		\$112,963.00	\$102,693
D3060	Controls & Instrumentation	\$0.00	S.F.		0				0.00 %	0.00 %				\$0
D3070	Systems Testing & Balance	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D3090	Other HVAC Systems/Equip - Kitchen Hood	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D4010	Sprinklers	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D4020	Standpipes	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D5010	Electrical Service/Distribution	\$5.77	S.F.	5,545	40	1951	1991		0.00 %	110.00 %	-24		\$35,194.00	\$31,995
D5020	Branch Wiring	\$6.73	S.F.	5,545	30	1951	1981		0.00 %	110.00 %	-34		\$41,050.00	\$37,318
D5020	Lighting	\$10.05	S.F.	5,545	30	1977	2007		0.00 %	110.00 %	-8		\$61,300.00	\$55,727
D5030	Communications and Security - Fire Alarm	\$1.44	S.F.	5,545	15	1977	1992		0.00 %	109.99 %	-23		\$8,783.00	\$7,985
D5030	Communications and Security - Security & CCTV	\$1.21	S.F.	5,545	15	1977	1992		0.00 %	110.00 %	-23		\$7,380.00	\$6,709
D5090	Other Electrical Systems - Emergency Generator	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
E1010	Commercial Equipment	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
E2010	Fixed Furnishings	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
<b>Total</b>									<b>8.20 %</b>	<b>72.40 %</b>			<b>\$663,397.00</b>	<b>\$916,325</b>

## Renewal Schedule

eComet forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the system listing. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

*Inflation Rate: 3%*

System	Current Deficiencies	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	Total
<b>Total:</b>	<b>\$663,397</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$18,654</b>	<b>\$14,099</b>	<b>\$0</b>	<b>\$696,151</b>
* A - Substructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A10 - Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1010 - Standard Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1020 - Special Foundations	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A1030 - Slab on Grade	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A20 - Basement Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A2010 - Basement Excavation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* A2020 - Basement Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B - Shell	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B10 - Superstructure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1010 - Floor Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B1020 - Roof Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B20 - Exterior Enclosure	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
* B2010 - Exterior Walls	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B2020 - Exterior Windows	\$21,736	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$21,736
B2030 - Exterior Doors	\$8,600	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$8,600
B30 - Roofing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
B3010 - Roof Coverings - BUR	\$126,260	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$126,260
B3020 - Roof Openings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C - Interiors	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C10 - Interior Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1010 - Partitions	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C1020 - Interior Doors	\$51,663	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$51,663
C1030 - Fittings	\$9,454	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$9,454
C20 - Stairs	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

## School Assessment Report - 1951, 1977 Building

* C2010 - Stair Construction	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C30 - Interior Finishes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3010 - Wall Finishes - Ceramic Tile	\$5,140	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$5,140
C3010 - Wall Finishes - Paint	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$14,099	\$0	\$14,099
C3010 - Wall Finishes - Wall Coverings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020 - Floor Finishes - Carpet	\$14,726	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$18,654	\$0	\$33,380
C3020 - Floor Finishes - Ceramic Tile	\$14,345	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$14,345
C3020 - Floor Finishes - Terrazzo	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020 - Floor Finishes - Vinyl Tile	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3020 - Floor Finishes - Wood	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
C3030 - Ceiling Finishes	\$60,873	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$60,873
D - Services	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D10 - Conveying	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D1010 - Elevators and Lifts	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D20 - Plumbing	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2010 - Plumbing Fixtures	\$30,132	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$30,132
D2020 - Domestic Water Distribution	\$23,422	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$23,422
D2030 - Sanitary Waste	\$26,411	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$26,411
D2040 - Rain Water Drainage	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D2090 - Other Plumbing Systems - Natural Gas	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D30 - HVAC	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3020 - Heat Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3030 - Cooling Generating Systems	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3040 - Distribution Systems & Exhaust Systems	\$3,965	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$3,965
D3050 - Terminal & Package Units	\$112,963	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$112,963
D3060 - Controls & Instrumentation	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3070 - Systems Testing & Balance	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D3090 - Other HVAC Systems/Equip - Kitchen Hood	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D40 - Fire Protection	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4010 - Sprinklers	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D4020 - Standpipes	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
D50 - Electrical	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

## School Assessment Report - 1951, 1977 Building


D5010 - Electrical Service/Distribution	\$35,194	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$35,194
D5020 - Branch Wiring	\$41,050	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$41,050
D5020 - Lighting	\$61,300	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$61,300
D5030 - Communications and Security - Fire Alarm	\$8,783	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$8,783
D5030 - Communications and Security - Security & CCTV	\$7,380	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$7,380
D5090 - Other Electrical Systems - Emergency Generator	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E - Equipment & Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E10 - Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E1010 - Commercial Equipment	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E20 - Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
E2010 - Fixed Furnishings	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0

\* Indicates non-renewable system




## Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and the forecasted capital renewal (system replacement) requirements over the next ten years.

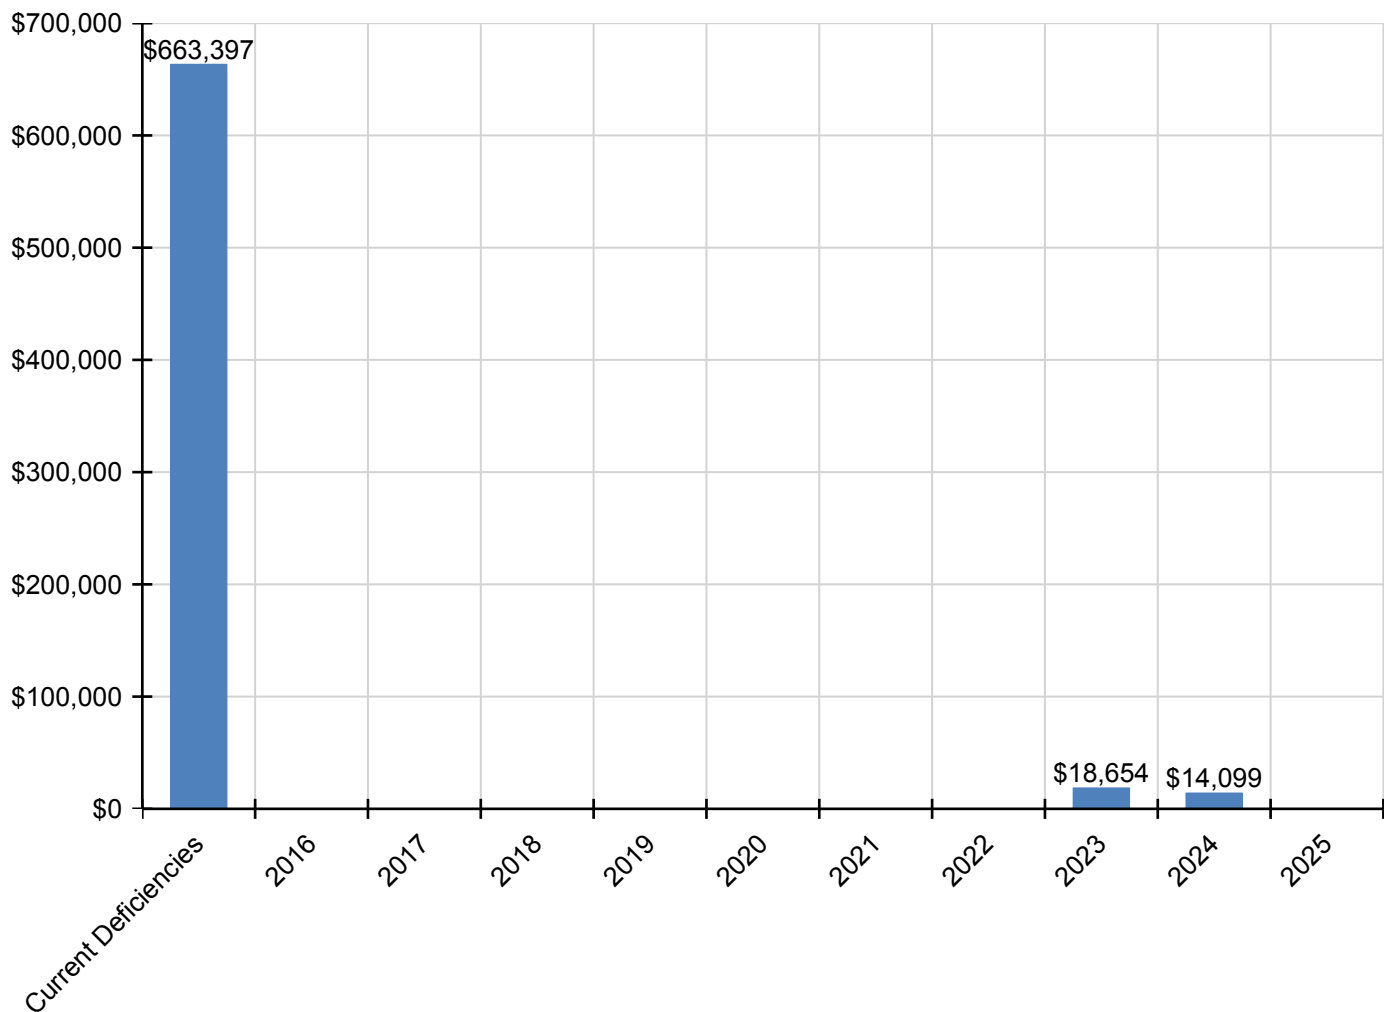

## Deficiency Summary by System


Current deficiencies include assemblies that have reached or exceed their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Service Life'. The following chart lists all current deficiencies associated with this facility broken down by UNIFORMAT system.

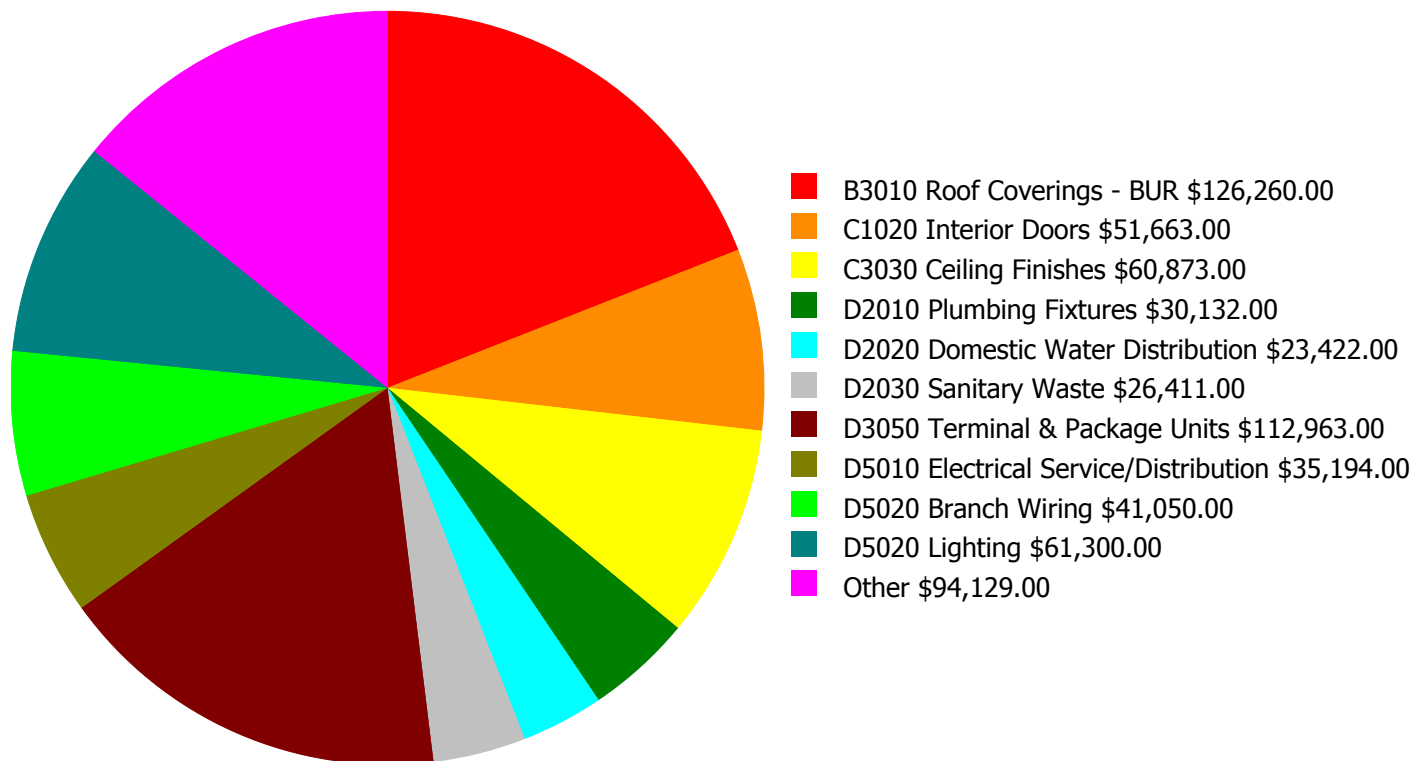

**Budget Estimate Total: \$663,397.00**

## Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

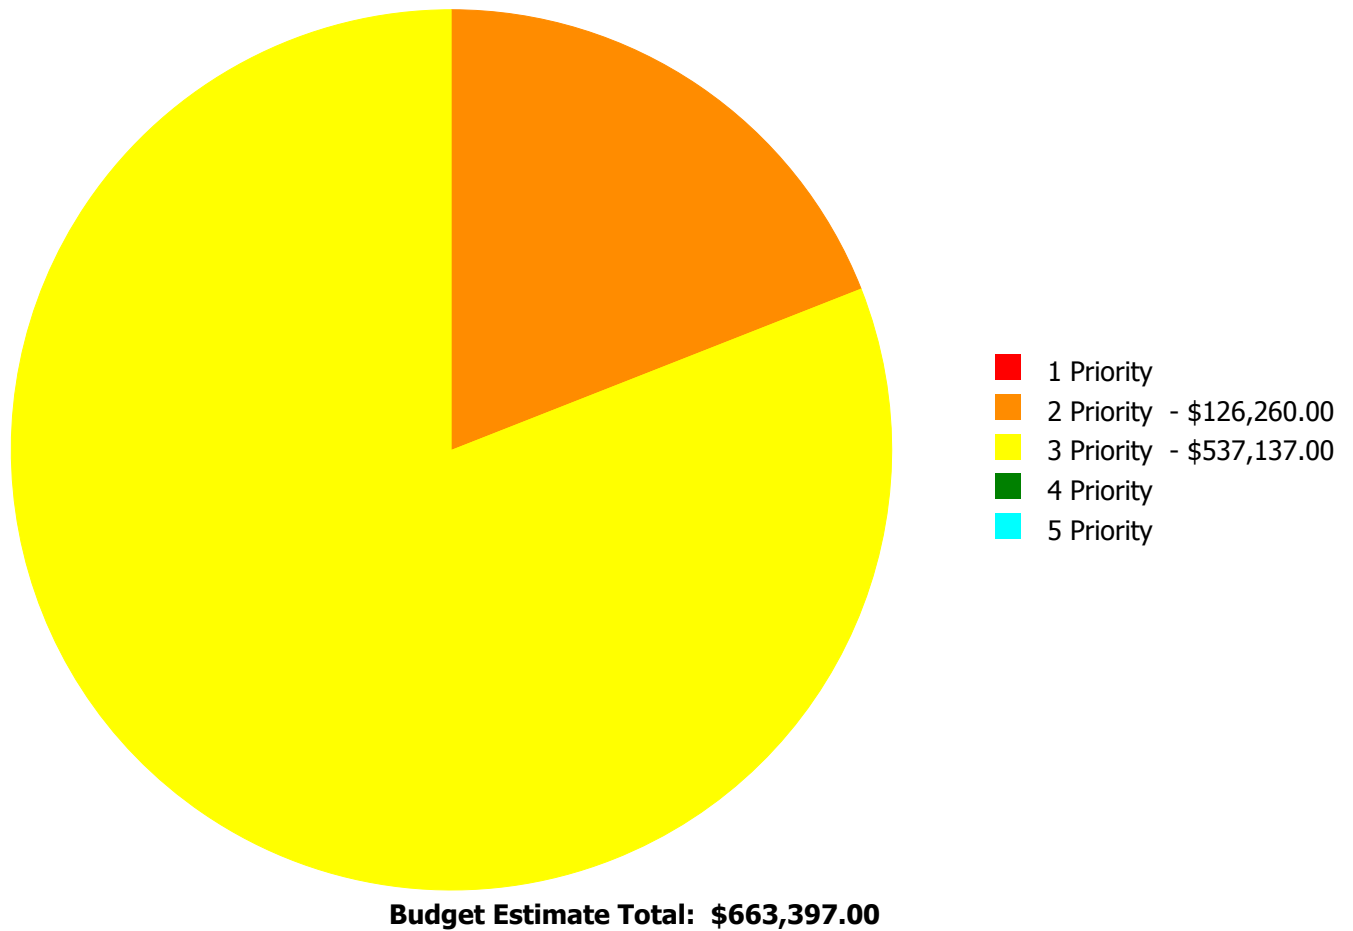

## Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

- **Priority 1** deficiencies require immediate review to correct a potential life/safety hazard, stop accelerated deterioration, or return a facility to operation.
- **Priority 2** deficiencies could become a Priority 1 deficiency, if not corrected within the next 2-3 years. These include intermittent operations, rapid deterioration, or potential life/safety hazards. .
- **Priority 3** deficiencies require appropriate attention to preclude predictable deterioration or potential downtime and the associated damage or higher costs if deferred further and not completed within the next 3-5 years.
- **Priority 4** deficiencies represent a sensible improvement to existing conditions. The recommended improvements are not required for the basic functionality of the facility; however addressing these deficiencies will improve overall usability and/or reduce long term maintenance costs. Repairs for these deficiencies may be budgeted and scheduled for completion within the next 5-7 years.
- **Priority 5** deficiencies will include conditions that have no impact on the function or usability of the facility, such as appearance. No action is required for these deficiencies, but they are tracked since they may require future inspection or be completed as part of related repairs in contiguous areas of the facility.

System Code	System Description	Priority 1	Priority 2	Priority 3	Priority 4	Priority 5	Total
B2020	Exterior Windows	\$0.00	\$0.00	\$21,736.00	\$0.00	\$0.00	\$21,736.00
B2030	Exterior Doors	\$0.00	\$0.00	\$8,600.00	\$0.00	\$0.00	\$8,600.00
B3010	Roof Coverings - BUR	\$0.00	\$126,260.00	\$0.00	\$0.00	\$0.00	\$126,260.00
C1020	Interior Doors	\$0.00	\$0.00	\$51,663.00	\$0.00	\$0.00	\$51,663.00
C1030	Fittings	\$0.00	\$0.00	\$9,454.00	\$0.00	\$0.00	\$9,454.00
C3010	Wall Finishes - Ceramic Tile	\$0.00	\$0.00	\$5,140.00	\$0.00	\$0.00	\$5,140.00
C3020	Floor Finishes - Carpet	\$0.00	\$0.00	\$14,726.00	\$0.00	\$0.00	\$14,726.00
C3020	Floor Finishes - Ceramic Tile	\$0.00	\$0.00	\$14,345.00	\$0.00	\$0.00	\$14,345.00
C3030	Ceiling Finishes	\$0.00	\$0.00	\$60,873.00	\$0.00	\$0.00	\$60,873.00
D2010	Plumbing Fixtures	\$0.00	\$0.00	\$30,132.00	\$0.00	\$0.00	\$30,132.00
D2020	Domestic Water Distribution	\$0.00	\$0.00	\$23,422.00	\$0.00	\$0.00	\$23,422.00
D2030	Sanitary Waste	\$0.00	\$0.00	\$26,411.00	\$0.00	\$0.00	\$26,411.00
D3040	Distribution Systems & Exhaust Systems	\$0.00	\$0.00	\$3,965.00	\$0.00	\$0.00	\$3,965.00
D3050	Terminal & Package Units	\$0.00	\$0.00	\$112,963.00	\$0.00	\$0.00	\$112,963.00
D5010	Electrical Service/Distribution	\$0.00	\$0.00	\$35,194.00	\$0.00	\$0.00	\$35,194.00
D5020	Branch Wiring	\$0.00	\$0.00	\$41,050.00	\$0.00	\$0.00	\$41,050.00
D5020	Lighting	\$0.00	\$0.00	\$61,300.00	\$0.00	\$0.00	\$61,300.00
D5030	Communications and Security - Fire Alarm	\$0.00	\$0.00	\$8,783.00	\$0.00	\$0.00	\$8,783.00
D5030	Communications and Security - Security & CCTV	\$0.00	\$0.00	\$7,380.00	\$0.00	\$0.00	\$7,380.00
	<b>Total:</b>	\$0.00	\$126,260.00	\$537,137.00	\$0.00	\$0.00	\$663,397.00

## Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

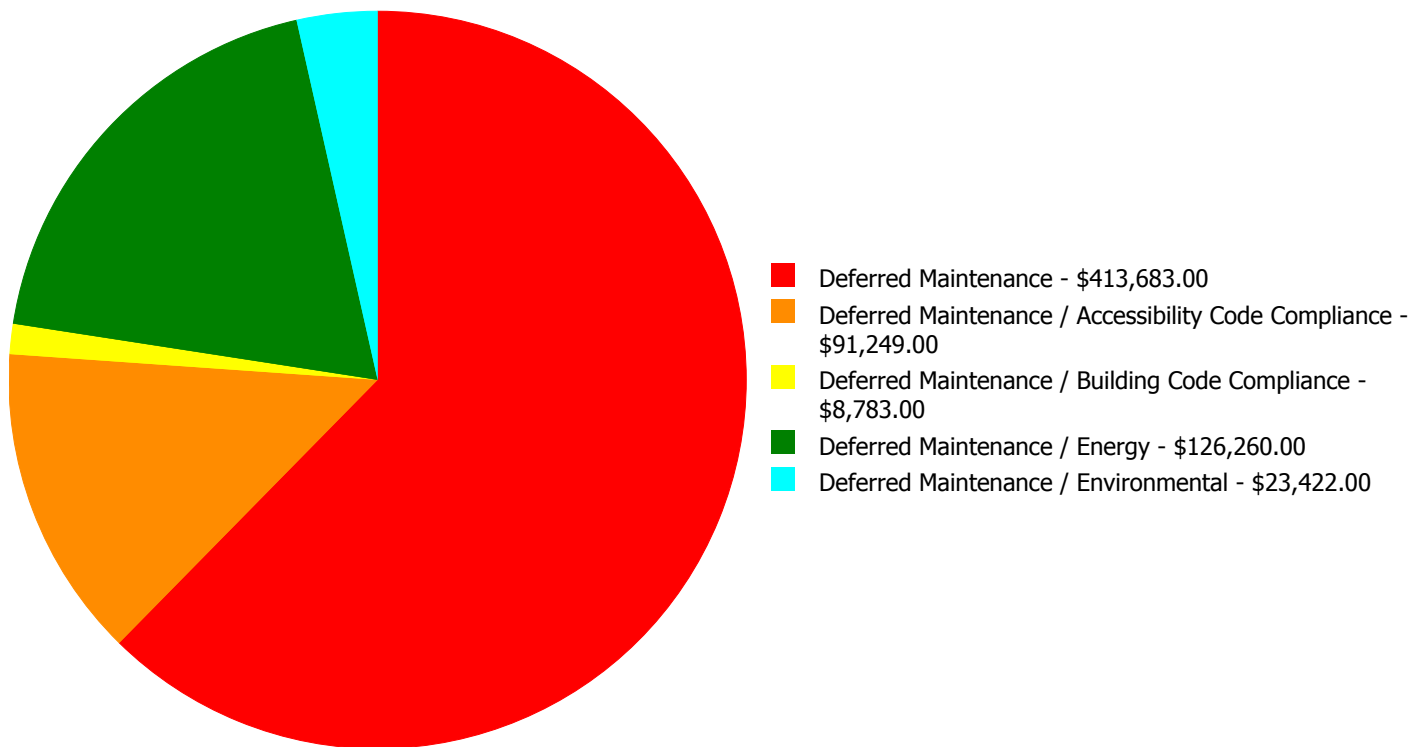

**Budget Estimate Total: \$663,397.00**

## Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

### Priority 2 Priority:

#### **System: B3010 - Roof Coverings - BUR**



**Location:** Roof

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Energy

**Priority:** 2 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$126,260.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The built-up roof covering is aged, showing signs of failure, has ponding water, and is scheduled for replacement under a SPLOST project 311-422.

---

**Priority 3 Priority:**

**System: B2020 - Exterior Windows**



**Location:** Observation Room

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$21,736.00


**Assessor Name:** Ben Nixon

**Date Created:** 06/26/2015

**Notes:** Exterior windows are beyond their expected service life and should be scheduled for replacement.

---

**System: B2030 - Exterior Doors**

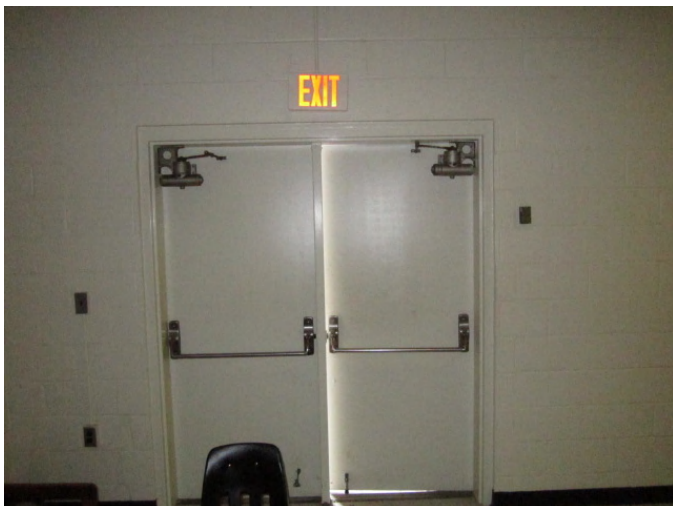

**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$8,600.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The system is beyond its expected service life and should be scheduled for replacement.

---



**System: C1020 - Interior Doors**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Accessibility Code Compliance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$51,663.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The interior doors are aged, failing, not ADA compliant, and should be scheduled for replacement.

---

**System: C1030 - Fittings**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Accessibility Code Compliance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$9,454.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** Fittings, such as toilet partitions, handrails and room signage, throughout the building are aged, in marginal condition, not ADA compliant, and should be scheduled for replacement.

---

**System: C3010 - Wall Finishes - Ceramic Tile**




**Location:** Restrooms  
**Distress:** Beyond Service Life  
**Category:** Deferred Maintenance  
**Priority:** 3 Priority  
**Correction:** Renew System  
**Qty:** 455.00  
**Unit of Measure:** S.F.  
**Estimate:** \$5,140.00  
**Assessor Name:** Ben Nixon  
**Date Created:** 04/11/2015

**Notes:** The ceramic tile in the restrooms is aged, chipped, and cracked, and should be replaced.

---

**System: C3020 - Floor Finishes - Carpet**

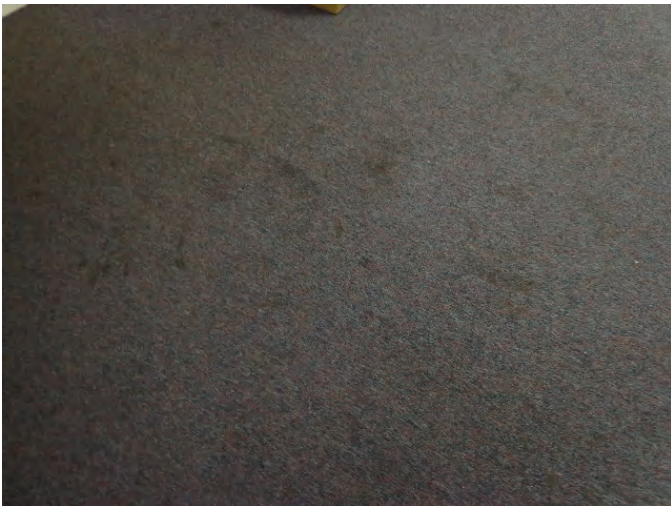

**Location:** Simulation Room  
**Distress:** Beyond Service Life  
**Category:** Deferred Maintenance  
**Priority:** 3 Priority  
**Correction:** Renew System  
**Qty:** 1,575.00  
**Unit of Measure:** S.F.  
**Estimate:** \$14,726.00  
**Assessor Name:** Ben Nixon  
**Date Created:** 04/11/2015

**Notes:** The carpet is aged, stained, frayed, and should be replaced.

---

**System: C3020 - Floor Finishes - Ceramic Tile**



**Location:** Restrooms

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 900.00

**Unit of Measure:** S.F.

**Estimate:** \$14,345.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The ceramic tile in the restrooms are aged, worn and should be replaced.

---

**System: C3030 - Ceiling Finishes**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$60,873.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The ceiling tiles have been replaced as needed. However the grid shows signs of aging and most tiles are sagging or damaged and should be replaced.

---



**System: D2010 - Plumbing Fixtures**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Accessibility Code Compliance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$30,132.00

**Assessor Name:** Sam Mandola

**Date Created:** 04/11/2015

**Notes:** Plumbing fixtures are beyond expected service life, failing, and should be replaced to improve ADA accessibility.

---

**System: D2020 - Domestic Water Distribution**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Environmental

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$23,422.00

**Assessor Name:** Sam Mandola

**Date Created:** 04/11/2015

**Notes:** The domestic water distribution system is aged, has water quality issues, and should be replaced. The water heater was removed and not reinstalled.

---

**System: D2030 - Sanitary Waste**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$26,411.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The sanitary waste system is aged, has reported periodic failures, and should be replaced.

---

**System: D3040 - Distribution Systems & Exhaust Systems**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$3,965.00

**Assessor Name:** Ben Nixon

**Date Created:** 05/11/2015

**Notes:** The exhaust system is original to the building age, beyond its expected service life, and non operational, and should be replaced.

---

**System: D3050 - Terminal & Package Units**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$112,963.00

**Assessor Name:** Sam Mandola

**Date Created:** 04/11/2015

**Notes:** The system is beyond its expected service life, failing, and should be scheduled for replacement.

---

**System: D5010 - Electrical Service/Distribution**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$35,194.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** Electrical service is beyond its expected service life and should be scheduled for replacement.

---

**System: D5020 - Branch Wiring**



**Location:** Throughout Building  
**Distress:** Beyond Service Life  
**Category:** Deferred Maintenance  
**Priority:** 3 Priority  
**Correction:** Renew System  
**Qty:** 5,545.00  
**Unit of Measure:** S.F.  
**Estimate:** \$41,050.00  
**Assessor Name:** Ben Nixon  
**Date Created:** 04/11/2015

**Notes:** Wiring is aged, failing, and should be replaced.

---

**System: D5020 - Lighting**



**Location:** Throughout Building  
**Distress:** Beyond Service Life  
**Category:** Deferred Maintenance  
**Priority:** 3 Priority  
**Correction:** Renew System  
**Qty:** 5,545.00  
**Unit of Measure:** S.F.  
**Estimate:** \$61,300.00  
**Assessor Name:** Ben Nixon  
**Date Created:** 04/11/2015

**Notes:** Lighting is aged, failing, and should be replaced. Staff reported that exterior building lighting is inadequate and there isn't any lighting at the main entrance or rear side of the building.

---



**System: D5030 - Communications and Security - Fire Alarm**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Building Code Compliance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$8,783.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The fire alarm is beyond its expected service life, failing, not code compliant, and should be scheduled for replacement.

---

**System: D5030 - Communications and Security - Security & CCTV**



**Location:** Throughout Building

**Distress:** Damaged

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,545.00

**Unit of Measure:** S.F.

**Estimate:** \$7,380.00

**Assessor Name:** Sam Mandola

**Date Created:** 04/11/2015

**Notes:** Both the security and CCTV systems are beyond their expected service life, damaged, and should be scheduled for replacement.

---

## Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Function:	Admin/Support
Gross Area (SF):	100
Year Built:	1977
Last Renovation:	
Replacement Value:	\$9,795
Repair Cost:	\$6,129.87
Total FCI:	62.58 %
Total RSLI:	16.90 %
FCA Score:	37.42



### Description:

The pump house at Doraville Administration Building is a one-story building located at 3932 Flowers Road in Atlanta, Georgia. There have been no additions or major renovations. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report.

### Attributes:

#### General Attributes:

Building Codes:	Fire Sprinkler System:	No
-----------------	------------------------	----

## Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
A10 - Foundations	62.00 %	0.00 %	\$0.00
A20 - Basement Construction	0.00 %	0.00 %	\$0.00
B10 - Superstructure	0.00 %	99.98 %	\$1,712.58
B20 - Exterior Enclosure	34.66 %	18.52 %	\$757.29
B30 - Roofing	0.00 %	110.00 %	\$2,277.00
C10 - Interior Construction	0.00 %	0.00 %	\$0.00
C30 - Interior Finishes	0.00 %	0.00 %	\$0.00
D20 - Plumbing	0.00 %	0.00 %	\$0.00
D50 - Electrical	0.98 %	88.48 %	\$1,383.00
<b>Totals:</b>	<b>16.90 %</b>	<b>62.58 %</b>	<b>\$6,129.87</b>

### Photo Album

The photo album consists of the various cardinal directions of the building.

1). West Elevation - May 04, 2015



2). South Elevation - May 04, 2015



3). East Elevation - May 04, 2015



4). North Elevation - May 04, 2015



### Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system.
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment).
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system.

## School Assessment Report - 1977 Pump House

### System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
A1010	Standard Foundations	\$0.00	S.F.		0				0.00 %	0.00 %				\$0
A1030	Slab on Grade	\$3.60	S.F.	100	100	1977	2077		62.00 %	0.00 %	62			\$360
A2010	Basement Excavation	\$0.00	S.F.	0	100				0.00 %	0.00 %				\$0
A2020	Basement Walls	\$0.00	S.F.	0	100				0.00 %	0.00 %				\$0
B1020	Roof Construction	\$17.13	S.F.	100	100	1977	2077	2015	0.00 %	99.98 %	0		\$1,712.58	\$1,713
B2010	Exterior Walls	\$38.65	S.F.	100	60	1977	2037		36.67 %	13.23 %	22		\$511.29	\$3,865
B2020	Exterior Windows	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
B2030	Exterior Doors	\$2.24	S.F.	100	30	1977	2007		0.00 %	109.82 %	-8		\$246.00	\$224
B3010	Roof Coverings - BUR	\$20.70	S.F.	100	25	1977	2002		0.00 %	110.00 %	-13		\$2,277.00	\$2,070
C1010	Partitions	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C1020	Interior Doors	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C1030	Fittings	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C3010	Wall Finishes	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C3020	Floor Finishes	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
C3030	Ceiling Finishes	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D2040	Rain Water Drainage	\$0.00	S.F.	0	0				0.00 %	0.00 %				\$0
D5010	Electrical Service/Distribution	\$3.06	S.F.	100	40	1977	2017		5.00 %	0.00 %	2			\$306
D5020	Lighting and Branch Wiring	\$12.57	S.F.	100	30	1977	2007		0.00 %	110.02 %	-8		\$1,383.00	\$1,257
<b>Total</b>									<b>16.90 %</b>	<b>62.58 %</b>			<b>\$6,129.87</b>	<b>\$9,795</b>

Renewal Schedule

eComet forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the system listing. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

*Inflation Rate: 3%*




# School Assessment Report - 1977 Pump House

System	Current Deficiencies	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	Total
<b>Total:</b>	<b>\$6,130</b>	<b>\$0</b>	<b>\$358</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$6,487</b>
<b>* A - Substructure</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* A10 - Foundations</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* A1010 - Standard Foundations</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* A1030 - Slab on Grade</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* A20 - Basement Construction</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* A2010 - Basement Excavation</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* A2020 - Basement Walls</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>B - Shell</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>B10 - Superstructure</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* B1020 - Roof Construction</b>	\$1,713	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,713
<b>B20 - Exterior Enclosure</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>* B2010 - Exterior Walls</b>	\$511	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$511
<b>B2020 - Exterior Windows</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>B2030 - Exterior Doors</b>	\$246	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$246
<b>B30 - Roofing</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>B3010 - Roof Coverings - BUR</b>	\$2,277	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$2,277
<b>C - Interiors</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C10 - Interior Construction</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C1010 - Partitions</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C1020 - Interior Doors</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C1030 - Fittings</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C30 - Interior Finishes</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C3010 - Wall Finishes</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C3020 - Floor Finishes</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>C3030 - Ceiling Finishes</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>D - Services</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>D20 - Plumbing</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>D2040 - Rain Water Drainage</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>D50 - Electrical</b>	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
<b>D5010 - Electrical Service/Distribution</b>	\$0	\$0	\$358	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$358
<b>D5020 - Lighting and Branch Wiring</b>	\$1,383	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$1,383

*\* Indicates non-renewable system*


Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and the forecasted capital renewal (system replacement) requirements over the next ten years.

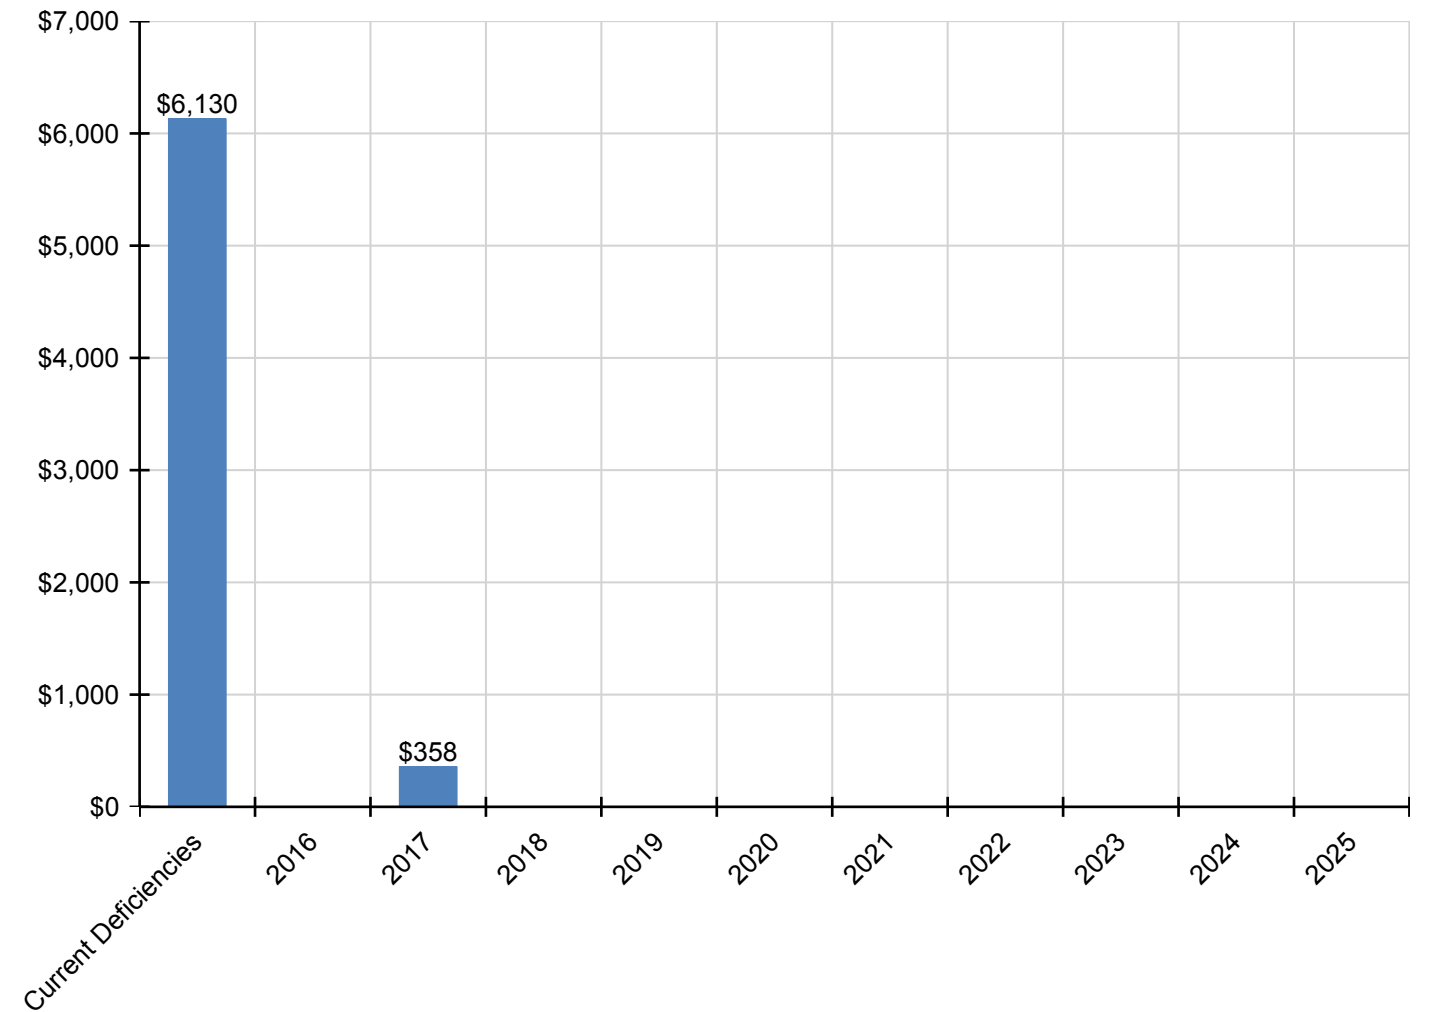

## Deficiency Summary by System


Current deficiencies include assemblies that have reached or exceed their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Service Life'. The following chart lists all current deficiencies associated with this facility broken down by UNIFORMAT system.

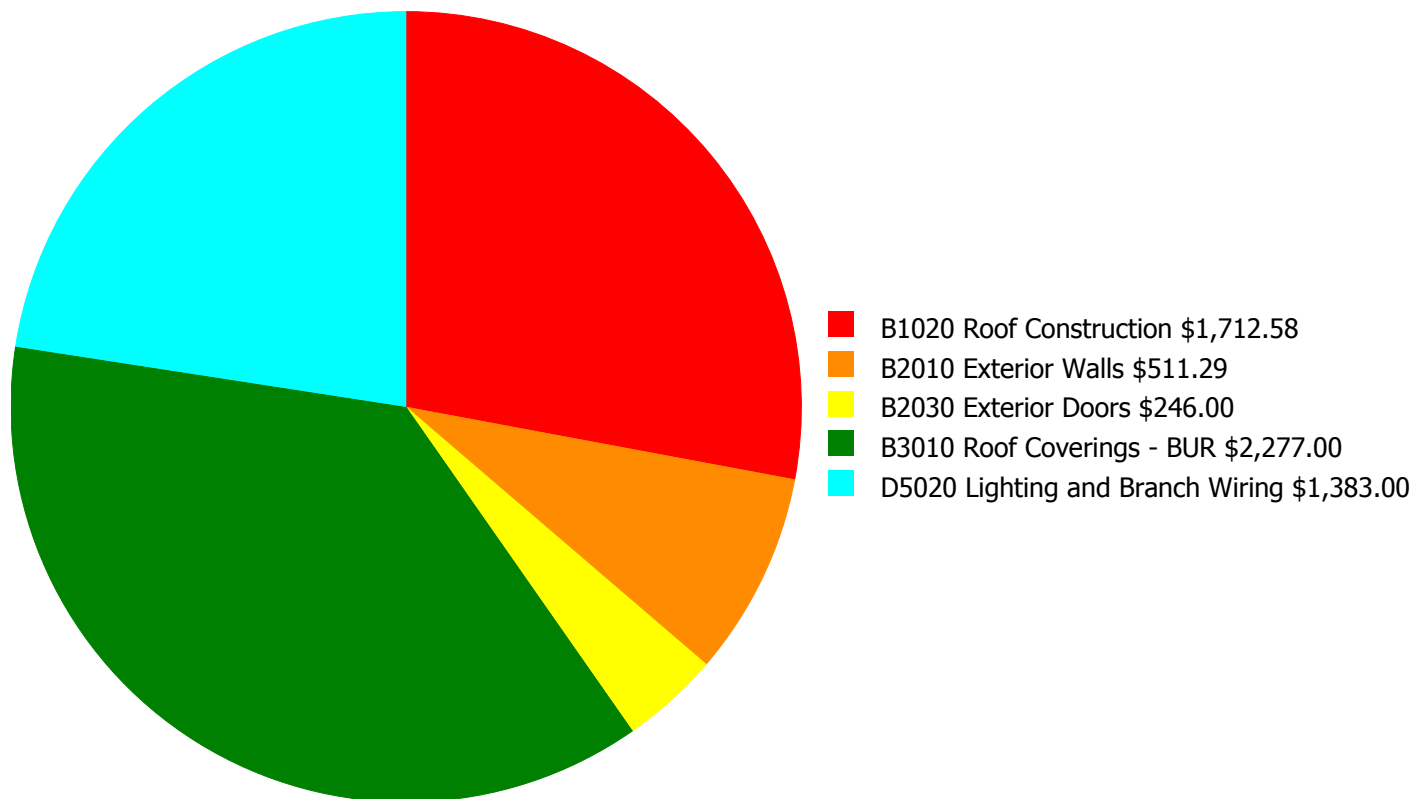

**Budget Estimate Total: \$6,129.87**

## Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

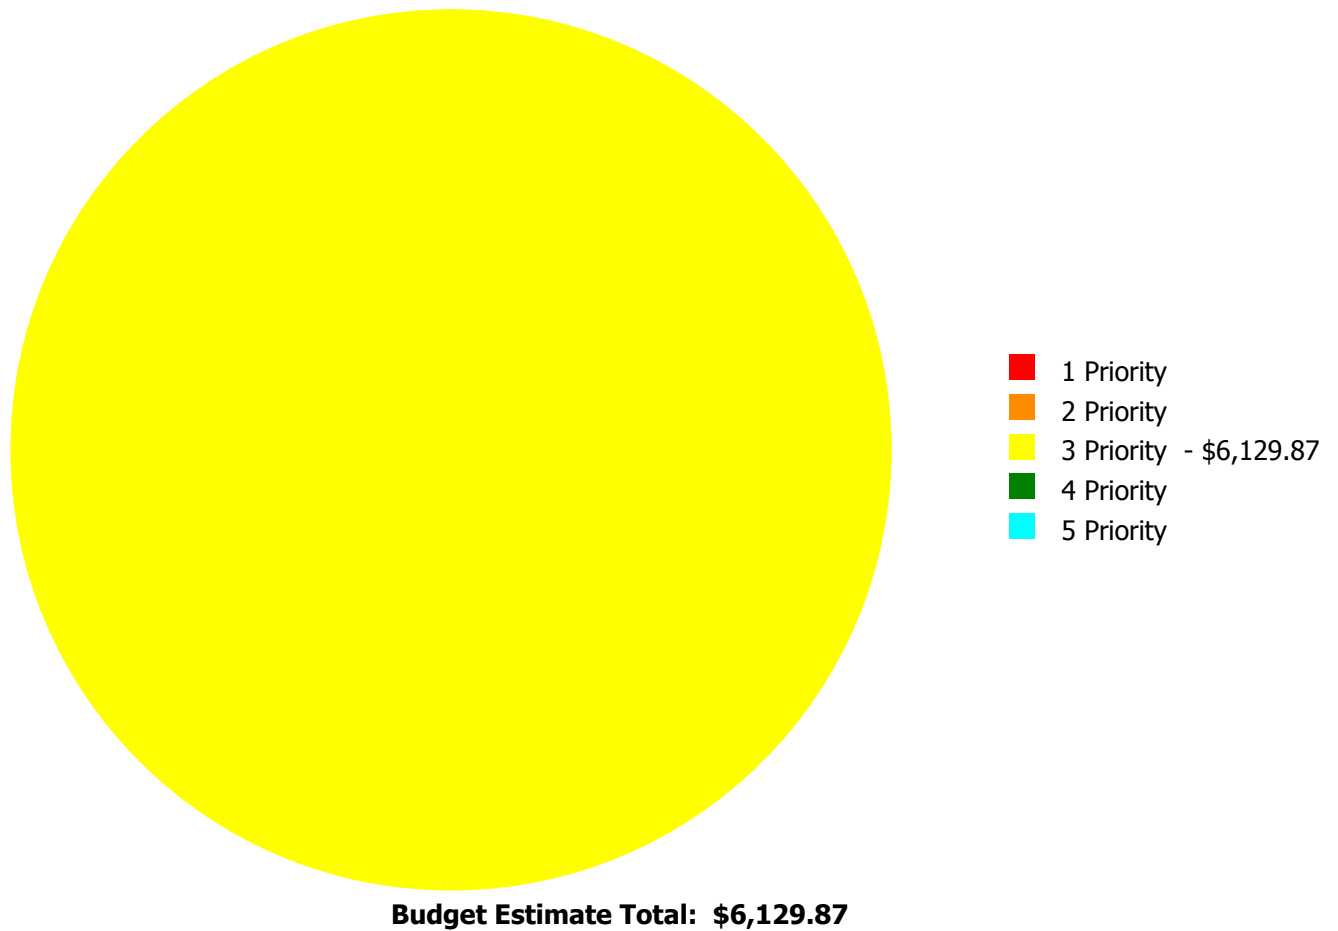

## Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

- **Priority 1** deficiencies require immediate review to correct a potential life/safety hazard, stop accelerated deterioration, or return a facility to operation.
- **Priority 2** deficiencies could become a Priority 1 deficiency, if not corrected within the next 2-3 years. These include intermittent operations, rapid deterioration, or potential life/safety hazards. .
- **Priority 3** deficiencies require appropriate attention to preclude predictable deterioration or potential downtime and the associated damage or higher costs if deferred further and not completed within the next 3-5 years.
- **Priority 4** deficiencies represent a sensible improvement to existing conditions. The recommended improvements are not required for the basic functionality of the facility; however addressing these deficiencies will improve overall usability and/or reduce long term maintenance costs. Repairs for these deficiencies may be budgeted and scheduled for completion within the next 5-7 years.
- **Priority 5** deficiencies will include conditions that have no impact on the function or usability of the facility, such as appearance. No action is required for these deficiencies, but they are tracked since they may require future inspection or be completed as part of related repairs in contiguous areas of the facility.

System Code	System Description	Priority 1	Priority 2	Priority 3	Priority 4	Priority 5	Total
B1020	Roof Construction	\$0.00	\$0.00	\$1,712.58	\$0.00	\$0.00	\$1,712.58
B2010	Exterior Walls	\$0.00	\$0.00	\$511.29	\$0.00	\$0.00	\$511.29
B2030	Exterior Doors	\$0.00	\$0.00	\$246.00	\$0.00	\$0.00	\$246.00
B3010	Roof Coverings - BUR	\$0.00	\$0.00	\$2,277.00	\$0.00	\$0.00	\$2,277.00
D5020	Lighting and Branch Wiring	\$0.00	\$0.00	\$1,383.00	\$0.00	\$0.00	\$1,383.00
	<b>Total:</b>	\$0.00	\$0.00	\$6,129.87	\$0.00	\$0.00	\$6,129.87

## Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

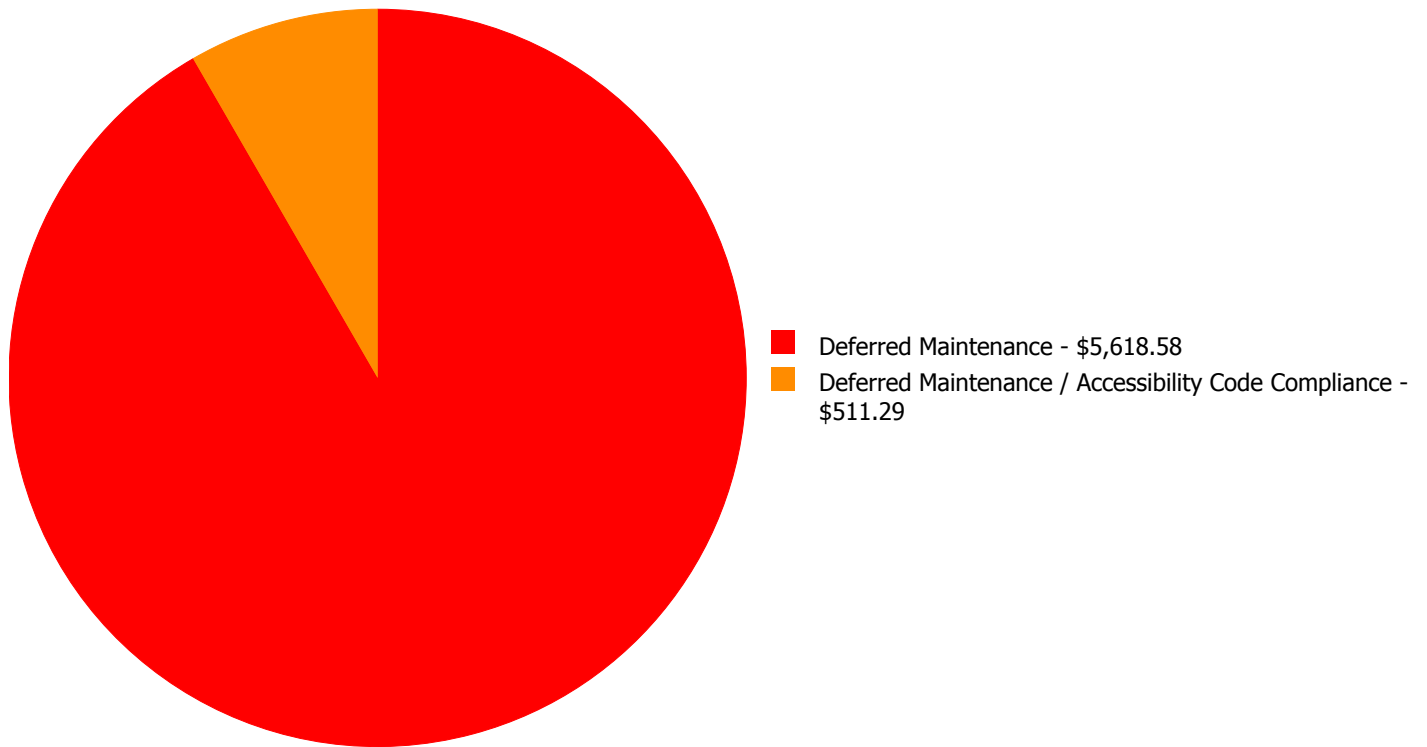

**Budget Estimate Total: \$6,129.87**

## Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

### Priority 3 Priority:

#### System: B1020 - Roof Construction



**Location:** Roof

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Replace entire roof (\$14.20/sf)

**Qty:** 100.00

**Unit of Measure:** S.F.

**Estimate:** \$1,712.58

**Assessor Name:** Ben Nixon

**Date Created:** 05/04/2015

**Notes:** The original metal roof construction is rusted, in poor condition, and should be replaced.

#### System: B2010 - Exterior Walls



**Location:** Exterior Walls

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Accessibility Code Compliance

**Priority:** 3 Priority

**Correction:** Repaint concrete block walls

**Qty:** 150.00

**Unit of Measure:** S.F.

**Estimate:** \$511.29

**Assessor Name:** Ben Nixon

**Date Created:** 05/04/2015

**Notes:** The exterior wall finishes are aged, faded and stained, and should be replaced.



## School Assessment Report - 1977 Pump House

---

### **System: B2030 - Exterior Doors**



**Location:** Exterior Wall

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 100.00

**Unit of Measure:** S.F.

**Estimate:** \$246.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The original exterior door is aged, rusted, and should be replaced.

---

### **System: B3010 - Roof Coverings - BUR**



**Location:** Roof

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 100.00

**Unit of Measure:** S.F.

**Estimate:** \$2,277.00

**Assessor Name:** Ben Nixon

**Date Created:** 05/04/2015

**Notes:** The roof covering is aging, showing signs of failure and should be replaced.

---

**System: D5020 - Lighting and Branch Wiring**



**Location:** Throughout Building

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 100.00

**Unit of Measure:** S.F.

**Estimate:** \$1,383.00

**Assessor Name:** Ben Nixon

**Date Created:** 04/11/2015

**Notes:** The original lighting and branch wiring system is operational, but is aged, in poor condition, and should be replaced.

---

## Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

Function:	Admin/Support
Gross Area (SF):	5,645
Year Built:	1951
Last Renovation:	
Replacement Value:	\$669,725
Repair Cost:	\$736,696.71
Total FCI:	110.00 %
Total RSLI:	0.00 %
FCA Score:	0.00



### Description:

The Doraville Administration site was originally constructed in 1951, has a total area of 3.3 acres, and is occupied by approximately 5,645 square feet of permanent building space. Campus site features include paved driveways and parking lot, and fencing. Site mechanical and electrical features include water, sewer, and site lighting. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report for the site features.

### Attributes:

#### General Attributes:

Site Code: 1180

## Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

UNIFORMAT Classification	RSLI %	FCI %	Current Repair Cost
G20 - Site Improvements	0.00 %	110.00 %	\$673,297.69
G30 - Site Mechanical Utilities	0.00 %	110.00 %	\$40,548.05
G40 - Site Electrical Utilities	0.00 %	110.00 %	\$22,850.97
<b>Totals:</b>	<b>0.00 %</b>	<b>110.00 %</b>	<b>\$736,696.71</b>

### Photo Album

The photo album consists of the various cardinal directions of the building.

1). Aerial Image of Doraville Administration -  
Jun 26, 2015



2). Above Ground Fuel Tank - Jun 26, 2015



### Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system.
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment).
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system.

## System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

System Code	System Description	Unit Price \$	UoM	Qty	Life	Year Installed	Calc Next Renewal Year	Next Renewal Year	RSLI%	FCI%	RSL	eCR	Deficiency \$	Replacement Value \$
G2010	Roadways	\$5.17	S.F.	73,868	25	1980	2005		0.00 %	110.00 %	-10		\$420,087.32	\$381,898
G2020	Parking Lots	\$4.56	S.F.	47,559	25	1980	2005		0.00 %	110.00 %	-10		\$238,555.94	\$216,869
G2030	Pedestrian Paving	\$1.50	S.F.		0				0.00 %	0.00 %				\$0
G2040	Baseball Field	\$8.35	S.F.		0				0.00 %	0.00 %				\$0
G2040	Canopies	\$0.29	S.F.		0				0.00 %	0.00 %				\$0
G2040	Covered Walkways	\$48.72	S.F.		0				0.00 %	0.00 %				\$0
G2040	Fencing & Guardrails	\$0.91	S.F.	5,645	25	1985	2010		0.00 %	110.00 %	-5		\$5,650.65	\$5,137
G2040	Football Field	\$5.85	S.F.		0				0.00 %	0.00 %				\$0
G2040	Hard Surface Play Area	\$6.26	S.F.		0				0.00 %	0.00 %				\$0
G2040	Playing Field	\$3.92	S.F.		0				0.00 %	0.00 %				\$0
G2040	Soccer/Lacross Field	\$5.00	S.F.		0				0.00 %	0.00 %				\$0
G2040	Softball Field	\$8.86	S.F.		0				0.00 %	0.00 %				\$0
G2040	Tennis Courts	\$18.47	S.F.		0				0.00 %	0.00 %				\$0
G2040	Track	\$7.04	S.F.		0				0.00 %	0.00 %				\$0
G2050	Landscaping	\$1.45	S.F.	5,645	15	1951	1966		0.00 %	110.00 %	-49		\$9,003.78	\$8,185
G3010	Water Supply	\$1.83	S.F.	5,645	50	1951	2001		0.00 %	110.00 %	-14		\$11,363.39	\$10,330
G3020	Sanitary Sewer	\$1.15	S.F.	5,645	50	1951	2001		0.00 %	110.00 %	-14		\$7,140.93	\$6,492
G3030	Storm Sewer	\$3.55	S.F.	5,645	50	1951	2001		0.00 %	110.00 %	-14		\$22,043.73	\$20,040
G3060	Fuel Distribution -Fuel Storage Tank	\$0.13	Ea.	1	50	1977	2027		24.00 %	0.00 %	12			\$0
G4010	Electrical Distribution	\$1.86	S.F.	5,645	50	1951	2001		0.00 %	110.00 %	-14		\$11,549.67	\$10,500
G4020	Site Lighting	\$1.15	S.F.	5,645	30	1951	1981		0.00 %	110.00 %	-34		\$7,140.93	\$6,492
G4030	Site Communications & Security	\$0.67	S.F.	5,645	10	1985	1995		0.00 %	110.00 %	-20		\$4,160.37	\$3,782
<b>Total</b>									<b>0.00 %</b>	<b>110.00 %</b>			<b>\$736,696.71</b>	<b>\$669,725</b>

**Renewal Schedule**

eComet forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the system listing. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.



## School Assessment Report - Site


Inflation Rate: 3%

System	Current Deficiencies	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	Total
<b>Total:</b>	<b>\$736,697</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$0</b>	<b>\$5,591</b>	<b>\$742,287</b>
G - Building Sitework	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G20 - Site Improvements	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2010 - Roadways	\$420,087	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$420,087
G2020 - Parking Lots	\$238,556	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$238,556
G2030 - Pedestrian Paving	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Baseball Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Canopies	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Covered Walkways	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Fencing & Guardrails	\$5,651	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$5,651
G2040 - Football Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Hard Surface Play Area	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Playing Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Soccer/Lacross Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Softball Field	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Tennis Courts	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2040 - Track	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G2050 - Landscaping	\$9,004	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$9,004
G30 - Site Mechanical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G3010 - Water Supply	\$11,363	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$11,363
G3020 - Sanitary Sewer	\$7,141	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$7,141
G3030 - Storm Sewer	\$22,044	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$22,044
G3060 - Fuel Distribution -Fuel Storage Tank	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G40 - Site Electrical Utilities	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
G4010 - Electrical Distribution	\$11,550	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$11,550
G4020 - Site Lighting	\$7,141	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$7,141
G4030 - Site Communications & Security	\$4,160	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$5,591	\$9,751

\* Indicates non-renewable system


Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and the forecasted capital renewal (system replacement) requirements over the next ten years.

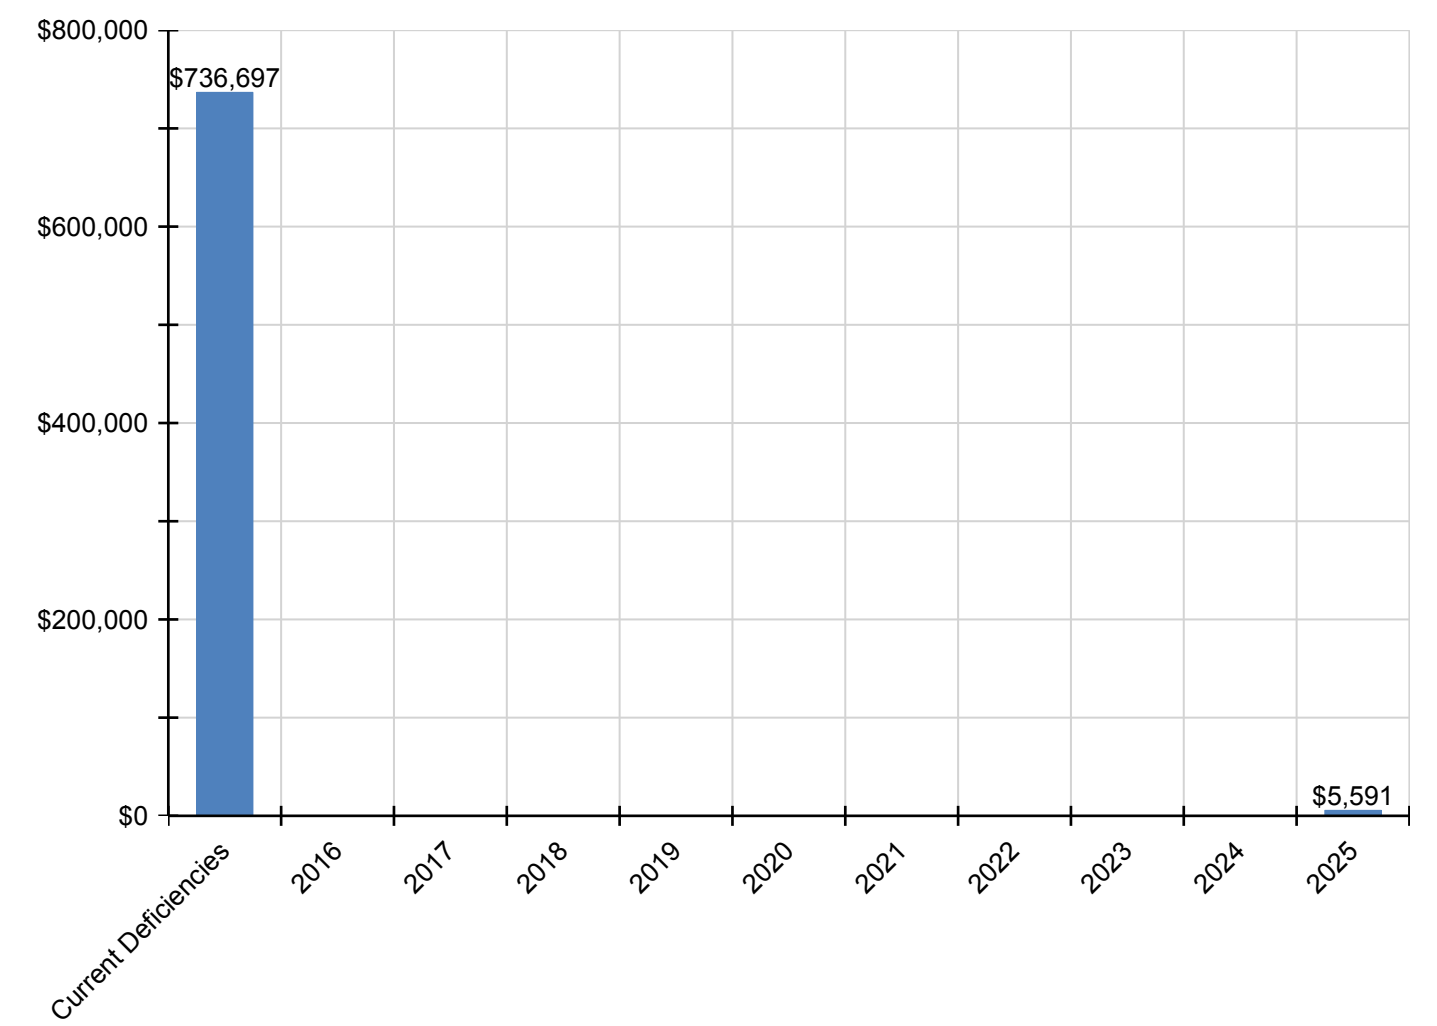

## Deficiency Summary by System


Current deficiencies include assemblies that have reached or exceed their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Service Life'. The following chart lists all current deficiencies associated with this facility broken down by UNIFORMAT system.

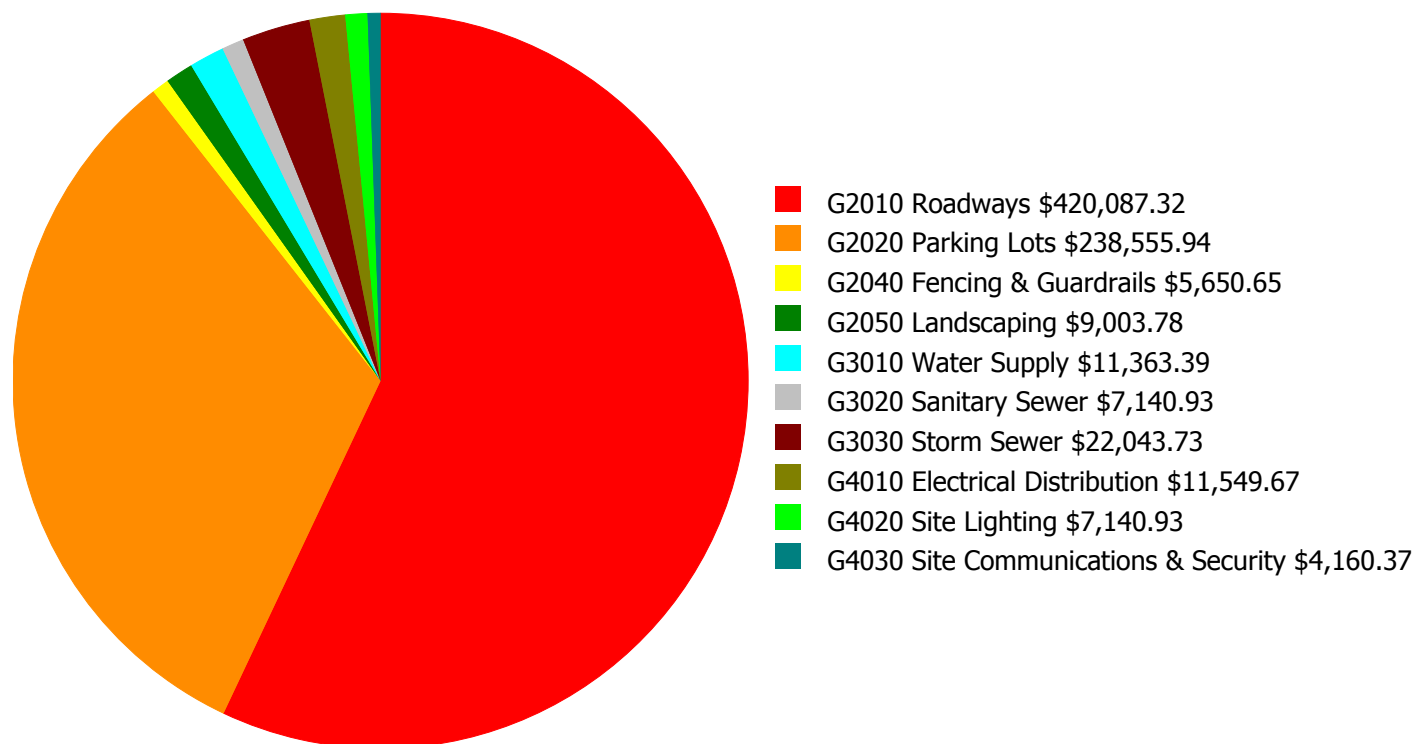

**Budget Estimate Total: \$736,696.71**

## Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

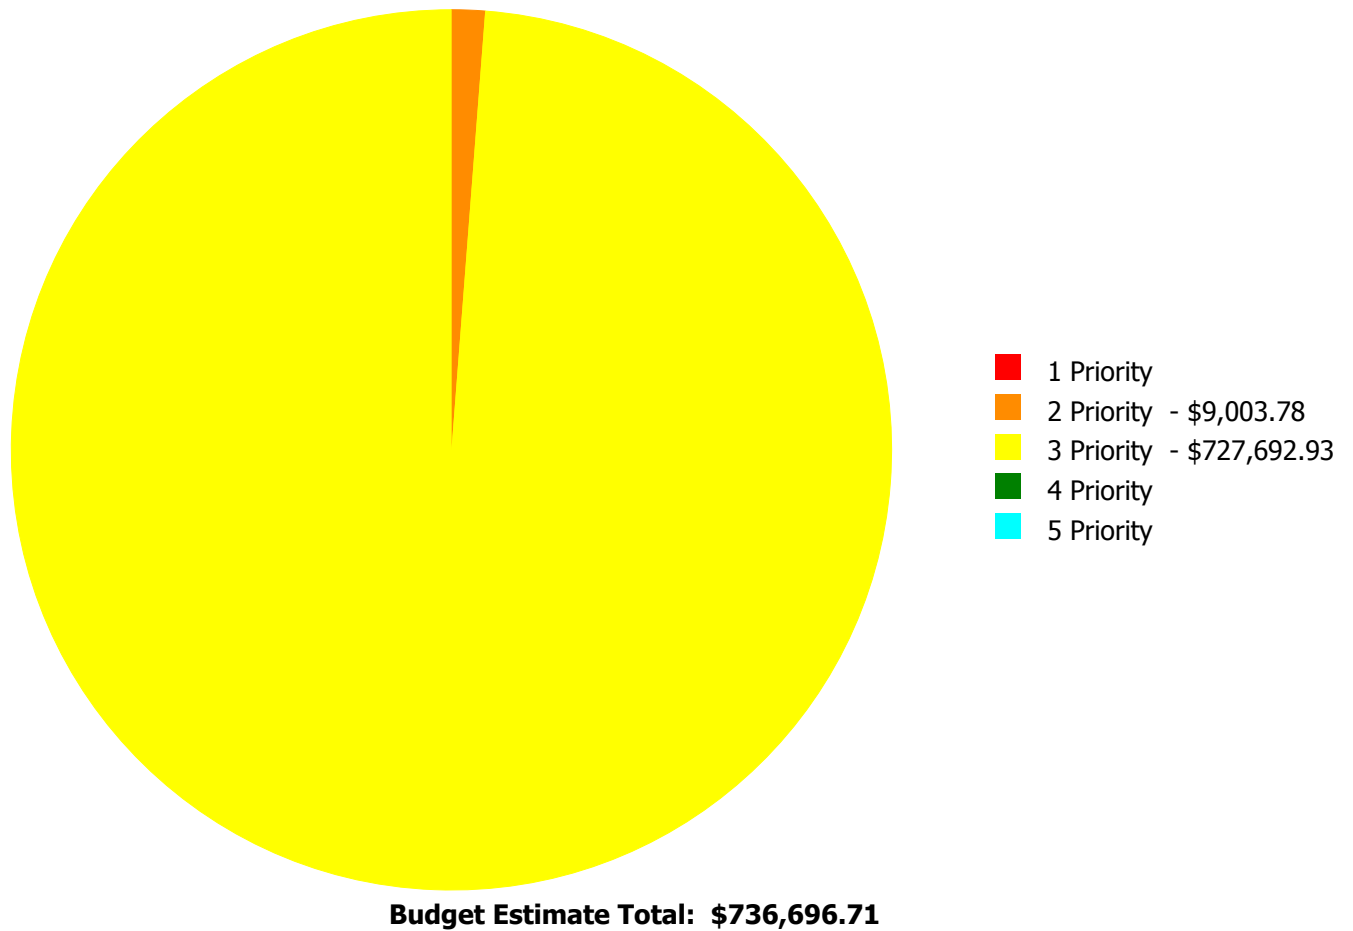

## Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

- **Priority 1** deficiencies require immediate review to correct a potential life/safety hazard, stop accelerated deterioration, or return a facility to operation.
- **Priority 2** deficiencies could become a Priority 1 deficiency, if not corrected within the next 2-3 years. These include intermittent operations, rapid deterioration, or potential life/safety hazards. .
- **Priority 3** deficiencies require appropriate attention to preclude predictable deterioration or potential downtime and the associated damage or higher costs if deferred further and not completed within the next 3-5 years.
- **Priority 4** deficiencies represent a sensible improvement to existing conditions. The recommended improvements are not required for the basic functionality of the facility; however addressing these deficiencies will improve overall usability and/or reduce long term maintenance costs. Repairs for these deficiencies may be budgeted and scheduled for completion within the next 5-7 years.
- **Priority 5** deficiencies will include conditions that have no impact on the function or usability of the facility, such as appearance. No action is required for these deficiencies, but they are tracked since they may require future inspection or be completed as part of related repairs in contiguous areas of the facility.

System Code	System Description	Priority 1	Priority 2	Priority 3	Priority 4	Priority 5	Total
G2010	Roadways	\$0.00	\$0.00	\$420,087.32	\$0.00	\$0.00	\$420,087.32
G2020	Parking Lots	\$0.00	\$0.00	\$238,555.94	\$0.00	\$0.00	\$238,555.94
G2040	Fencing & Guardrails	\$0.00	\$0.00	\$5,650.65	\$0.00	\$0.00	\$5,650.65
G2050	Landscaping	\$0.00	\$9,003.78	\$0.00	\$0.00	\$0.00	\$9,003.78
G3010	Water Supply	\$0.00	\$0.00	\$11,363.39	\$0.00	\$0.00	\$11,363.39
G3020	Sanitary Sewer	\$0.00	\$0.00	\$7,140.93	\$0.00	\$0.00	\$7,140.93
G3030	Storm Sewer	\$0.00	\$0.00	\$22,043.73	\$0.00	\$0.00	\$22,043.73
G4010	Electrical Distribution	\$0.00	\$0.00	\$11,549.67	\$0.00	\$0.00	\$11,549.67
G4020	Site Lighting	\$0.00	\$0.00	\$7,140.93	\$0.00	\$0.00	\$7,140.93
G4030	Site Communications & Security	\$0.00	\$0.00	\$4,160.37	\$0.00	\$0.00	\$4,160.37
	<b>Total:</b>	\$0.00	\$9,003.78	\$727,692.93	\$0.00	\$0.00	\$736,696.71

## Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

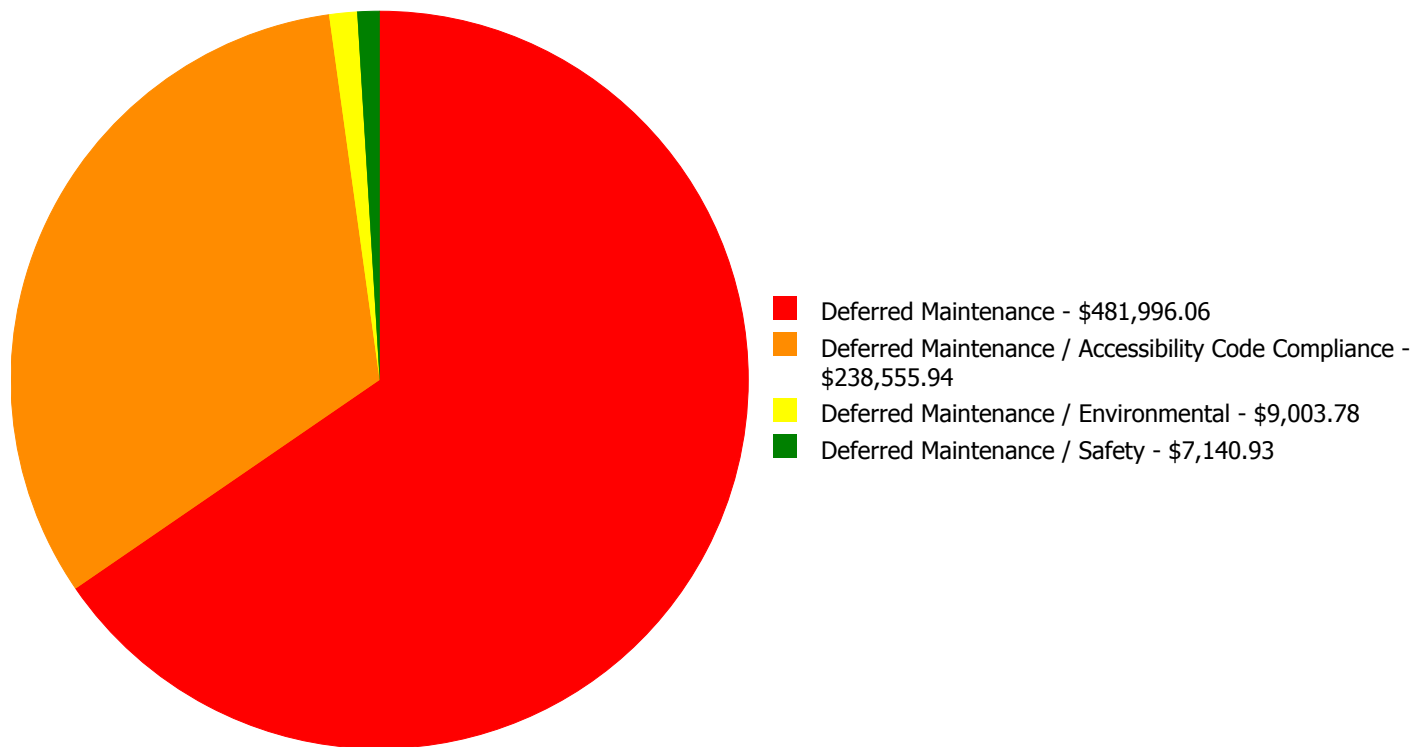

**Budget Estimate Total: \$736,696.71**

## Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

### Priority 2 Priority:

#### **System: G2050 - Landscaping**



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Environmental

**Priority:** 2 Priority

**Correction:** Renew System

**Qty:** 5,645.00

**Unit of Measure:** S.F.

**Estimate:** \$9,003.78

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** Landscaping is non-existent; many areas are overgrown weeds or completely eroded away, causing sediments to accumulate at lower levels of parking area and into storm sewer system. Landscaping should be provided.

---



**Priority 3 Priority:**

**System: G2010 - Roadways**



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 73,868.00

**Unit of Measure:** S.F.

**Estimate:** \$420,087.32

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** Roadways are beyond service life, damaged, and should be replaced.

---

**System: G2020 - Parking Lots**



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance / Accessibility Code Compliance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 47,559.00

**Unit of Measure:** S.F.

**Estimate:** \$238,555.94

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** The parking lot is beyond service life, damaged with pot holes, not ADA compliant, and should be scheduled for replacement.

---

## School Assessment Report - Site

---

### **System: G2040 - Fencing & Guardrails**



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,645.00

**Unit of Measure:** S.F.

**Estimate:** \$5,650.65

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** The fence and gates are beyond expected life, rusted, and falling, and should be scheduled for replacement.

---

### **System: G3010 - Water Supply**



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,645.00

**Unit of Measure:** S.F.

**Estimate:** \$11,363.39

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** The domestic water supply system is beyond its expected service life and should be scheduled for replacement.

---

## School Assessment Report - Site

---

### System: G3020 - Sanitary Sewer



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,645.00

**Unit of Measure:** S.F.

**Estimate:** \$7,140.93

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** The sanitary sewer system is aged, has reported periodic failures, and should be scheduled for replacement.

---

### System: G3030 - Storm Sewer



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,645.00

**Unit of Measure:** S.F.

**Estimate:** \$22,043.73

**Assessor Name:** Eduardo Lopez

**Date Created:** 04/27/2015

**Notes:** The storm sewer system is aged, in marginal condition, and should be scheduled for replacement.

---



**System: G4010 - Electrical Distribution**



**Location:** Site  
**Distress:** Beyond Service Life  
**Category:** Deferred Maintenance  
**Priority:** 3 Priority  
**Correction:** Renew System  
**Qty:** 5,645.00  
**Unit of Measure:** S.F.  
**Estimate:** \$11,549.67  
**Assessor Name:** Eduardo Lopez  
**Date Created:** 04/27/2015

**Notes:** The original electrical service is operational, but is beyond its expected service life, in poor condition and should be scheduled for replacement.

---

**System: G4020 - Site Lighting**



**Location:** Site  
**Distress:** Beyond Service Life  
**Category:** Deferred Maintenance / Safety  
**Priority:** 3 Priority  
**Correction:** Renew System  
**Qty:** 5,645.00  
**Unit of Measure:** S.F.  
**Estimate:** \$7,140.93  
**Assessor Name:** Sam Mandola  
**Date Created:** 04/27/2015

**Notes:** Site lighting is beyond its expected service life and should be scheduled for replacement and upgrading to provide increase coverage.

---

**System: G4030 - Site Communications & Security**



**Location:** Site

**Distress:** Beyond Service Life

**Category:** Deferred Maintenance

**Priority:** 3 Priority

**Correction:** Renew System

**Qty:** 5,645.00

**Unit of Measure:** S.F.

**Estimate:** \$4,160.37

**Assessor Name:** Eduardo Lopez

**Date Created:** 05/12/2015

**Notes:** Site communications and security is beyond its expected service life and should be scheduled for replacement.

---

## Glossary

Abandoned	A facility owned by a district that is not occupied and not maintained. See Vacant.
Additional Cost	Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET® database at the owner's discretion.
Assessment	Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality.
ASTM	ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services.
BOMA	Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies.
Building	A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior.
Building Addition	An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1983 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life.
Building Systems	eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system.
Calculated Next Renewal	The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system.
Capital Renewal	Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal.
City Cost Index (CCI)	RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value.
Condition	Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use.
Condition Budget	The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work.

## School Assessment Report - Doraville Administration

---

Condition Index (CI) %	The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life).
Construction Specifications Institute	Construction Specifications Institute: Primary national organization specializing in construction materials data and data location in construction documents. eCOMET® reference: UNIFORMAT II materials classification.
Correction	Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction.
Cost Model	A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models.
Criteria	Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score.
Current Period	The Current Period is the current year plus a user defined number of forward years.
Current Replacement Value (CRV)	The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost.
Deferred Maintenance	Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available.
Deficiency	A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose.
Deficiency Category	Deficiency Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety.
Deficiency Distress	Deficiency Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing.
Deficiency Priority	Deficiency Priority refers to a deficiency's urgency for repair as determined by the assessment team. Deficiencies were assigned a priority of 1 through 5, with Priority 1 deficiencies being the most urgent.
eCOMET®	Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program.



## School Assessment Report - Doraville Administration

---

eCOMET® Cost Models	eCOMET® cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends.
Element	Elements are the major components that comprise building systems as defined by UNIFORMAT II.
Expected Life	Also referred to as Useful Life. See Useful Life definition.
Facility	A facility refers to site(s), building(s), or building addition(s), or combinations thereof that provide a particular service or support of an educational purpose.
Facility Attributes	Customizable eCOMET® fields to identify attributes specific to a facility. These fields are part of the eCOMET® database set-up with the owner.
Facility Condition Assessment (FCA)	A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization.
Facility Condition Index (FCI)	FCI is an industry-standard measurement of a facility's condition expressed as a percentage from 0.00% to 100.00% that is derived by dividing the cost to correct a facility's deficiencies by its Current Replacement Value (CRV). The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio, a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities.
Forecast Period	The Forecast Period refers to a user defined number of years forward of the Current Period.
Gen (Generate)	The Cost Model has a Gen box for each system line item. By checking the box, eCOMET® will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than renew those systems.
Gross Square Feet (GSF)	The area of the enclosed floor space of a building or building addition in square feet measured to the outside face of the enclosing wall.
Life cycle	Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs.
Next Renewal	Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions.

## School Assessment Report - Doraville Administration

---

Order of Magnitude	Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values.
Remaining Service Life (RSL)	RSL is the number of years of service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the Calculated Next Renewal date or the Next Renewal date whichever one is the later date.
Renewal Factors	Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%.
Renewal Schedule	A timeline by year that indicates when the systems will need to be renewed and the estimated price of the renewal.
Repair Cost	Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes.
Replacement Value	See Current Replacement Value.
Site	A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility.
Soft Costs	Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses.
Sustainability	Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs.
System	System refers to building and related site work elements as described by ASTM UNIFORMAT II Classification for Building Elements (E1557-97), a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also UNIFORMAT II.
System Generated Deficiency	eCOMET® automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age.
UNIFORMAT	ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies.
Unit Price	The Unit Price (Raw) x (100% + the Additional Cost Template percentage).
Unit Price (Raw)	The actual \$/sq. ft cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility.

## School Assessment Report - Doraville Administration

---

Useful Life	Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience.
Vacant	Vacant refers to a facility that is not occupied but is a maintained facility by a district. See Abandoned.
Year Built	The year that a building or addition was originally built based on its date of substantial completion or occupancy.
Year Installed	The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced.