

DeKalb County School District/Leased/Charter

Former Shallowford Elementary

Final

School Assessment Report

May 19, 2016



Table of Contents

| | |
|------------------------------------|----|
| School Executive Summary | 3 |
| School Condition Summary | 4 |
| <u>1998 Gym</u> | 5 |
| Executive Summary | 5 |
| Condition Summary | 6 |
| Photo Album | 7 |
| Condition Detail | 8 |
| System Listing | 9 |
| Renewal Schedule | 11 |
| Forecasted Sustainment Requirement | 13 |
| Deficiency Summary By System | 14 |
| Deficiency Summary By Priority | 15 |
| Deficiency By Priority Investment | 16 |
| Deficiency Summary By Category | 17 |
| Deficiency Details By Priority | 18 |
| <u>Site</u> | 24 |
| Executive Summary | 24 |
| Condition Summary | 25 |
| Photo Album | 26 |
| Condition Detail | 27 |
| System Listing | 28 |
| Renewal Schedule | 29 |
| Forecasted Sustainment Requirement | 31 |
| Deficiency Summary By System | 32 |
| Deficiency Summary By Priority | 33 |
| Deficiency By Priority Investment | 34 |
| Deficiency Summary By Category | 35 |
| Deficiency Details By Priority | 36 |
| Glossary | 39 |

School Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

| | |
|--------------------|--------------|
| Gross Area (SF): | 5,488 |
| Year Built: | 1968 |
| Last Renovation: | 1998 |
| Replacement Value: | \$1,741,201 |
| Repair Cost: | \$353,158.40 |
| Total FCI: | 20.28 % |
| Total RSLI: | 33.89 % |
| FCA Score: | 79.72 |



Description:

The Former Shallowford Elementary School campus is located at 4680 Dunwoody Road in Dunwoody, Georgia. The school was demolished in 2014 as part of SPLOST IV and the 1998 gym building is all that remains. The gym is leased to a local community group for athletic training. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report for each building and site improvement on the campus.

Attributes:

General Attributes:

| | | | |
|---------------------|-------------|----------------------|--------------------------------|
| Assigned Region: | Region 1 | Board District: | District 1 |
| DOE Facility: | 299 | Geographic Region: | Region 1 |
| HS Attendance Area: | Dunwoody HS | Jurisdictional City: | DeKalb County (Unincorporated) |
| Site Acreage: | 9.1 | | |

School Condition Summary

The Table below shows the RSLI and FCI for each major system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

Current Investment Requirement and Condition by Uniformat Classification

| UNIFORMAT Classification | RSLI% | FCI % | Current Repair |
|---------------------------------|----------------|----------------|---------------------|
| A10 - Foundations | 83.00 % | 0.00 % | \$0.00 |
| B10 - Superstructure | 83.00 % | 0.00 % | \$0.00 |
| B20 - Exterior Enclosure | 61.33 % | 0.00 % | \$0.00 |
| B30 - Roofing | 77.33 % | 6.29 % | \$4,110.19 |
| C10 - Interior Construction | 60.77 % | 18.58 % | \$20,887.00 |
| C30 - Interior Finishes | 18.48 % | 12.82 % | \$15,418.04 |
| D20 - Plumbing | 43.60 % | 0.82 % | \$749.95 |
| D30 - HVAC | 12.79 % | 76.42 % | \$70,329.00 |
| D40 - Fire Protection | 0.00 % | 110.09 % | \$906.00 |
| D50 - Electrical | 35.67 % | 23.52 % | \$19,011.58 |
| E10 - Equipment | 15.00 % | 0.00 % | \$0.00 |
| G20 - Site Improvements | 11.69 % | 32.43 % | \$218,069.68 |
| G30 - Site Mechanical Utilities | 6.69 % | 0.00 % | \$0.00 |
| G40 - Site Electrical Utilities | 16.57 % | 18.21 % | \$3,676.96 |
| Totals: | 33.89 % | 20.28 % | \$353,158.40 |

Condition Deficiency Priority

| Facility Name | Gross Area (S.F.) | FCI % | 1 Priority | 2 Priority | 3 Priority | 4 Priority | 5 Priority |
|---------------|-------------------|--------------|--------------------|-----------------|---------------------|---------------|---------------|
| 1998 Gym | 5,488 | 13.03 | \$13,699.58 | \$906.00 | \$116,806.18 | \$0.00 | \$0.00 |
| Site | 5,488 | 30.27 | \$0.00 | \$0.00 | \$221,746.64 | \$0.00 | \$0.00 |
| Total: | | 20.28 | \$13,699.58 | \$906.00 | \$338,552.82 | \$0.00 | \$0.00 |

Deficiencies By Priority



Budget Estimate Total: \$353,158.40

Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as 100-Total FCI (without the %) where 100 is best and 0 is worst condition.

| | |
|--------------------|--------------|
| Function: | Vacant |
| Gross Area (SF): | 5,488 |
| Year Built: | 1998 |
| Last Renovation: | |
| Replacement Value: | \$1,008,532 |
| Repair Cost: | \$131,411.76 |
| Total FCI: | 13.03 % |
| Total RSLI: | 50.11 % |
| FCA Score: | 86.97 |



Description:

The 1998 gymnasium at Former Shallowford Elementary School is a one-story building located at 4680 Chamblee Dunwoody Road in Dunwoody, Georgia. There have been no additions and no major renovations to this building. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report.

Attributes:

General Attributes:

| | | | |
|-----------------|------|------------------------|----|
| Building Codes: | 8020 | Fire Sprinkler System: | No |
|-----------------|------|------------------------|----|

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

| UNIFORMAT Classification | RSLI % | FCI % | Current Repair Cost |
|-----------------------------|----------------|----------------|---------------------|
| A10 - Foundations | 83.00 % | 0.00 % | \$0.00 |
| B10 - Superstructure | 83.00 % | 0.00 % | \$0.00 |
| B20 - Exterior Enclosure | 61.33 % | 0.00 % | \$0.00 |
| B30 - Roofing | 77.33 % | 6.29 % | \$4,110.19 |
| C10 - Interior Construction | 60.77 % | 18.58 % | \$20,887.00 |
| C30 - Interior Finishes | 18.48 % | 12.82 % | \$15,418.04 |
| D20 - Plumbing | 43.60 % | 0.82 % | \$749.95 |
| D30 - HVAC | 12.79 % | 76.42 % | \$70,329.00 |
| D40 - Fire Protection | 0.00 % | 110.09 % | \$906.00 |
| D50 - Electrical | 35.67 % | 23.52 % | \$19,011.58 |
| E10 - Equipment | 15.00 % | 0.00 % | \$0.00 |
| Totals: | 50.11 % | 13.03 % | \$131,411.76 |

Photo Album

The photo album consists of the various cardinal directions of the building.

1). East Elevation - Apr 27, 2015



2). South Elevation - Apr 27, 2015



3). West Elevation - Apr 27, 2015



4). North Elevation - Apr 27, 2015



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system.
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment).
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system.

System Listing

School Assessment Report - 1998 Gym

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

| System Code | System Description | Unit Price \$ | UoM | Qty | Life | Year Installed | Calc Next Renewal Year | Next Renewal Year | RSLI% | FCI% | RSL | eCR | Deficiency \$ | Replacement Value \$ |
|--------------|---|---------------|------|-------|------|----------------|------------------------|-------------------|----------------|----------------|-----|-----|---------------------|----------------------|
| A1010 | Standard Foundations | \$9.34 | S.F. | 5,488 | 100 | 1998 | 2098 | | 83.00 % | 0.00 % | 83 | | | \$51,258 |
| A1030 | Slab on Grade | \$6.21 | S.F. | 5,488 | 100 | 1998 | 2098 | | 83.00 % | 0.00 % | 83 | | | \$34,080 |
| B1020 | Roof Construction | \$21.36 | S.F. | 5,488 | 100 | 1998 | 2098 | | 83.00 % | 0.00 % | 83 | | | \$117,224 |
| B2010 | Exterior Walls | \$19.80 | S.F. | 5,488 | 60 | 1998 | 2058 | | 71.67 % | 0.00 % | 43 | | | \$108,662 |
| B2020 | Exterior Windows | \$9.36 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$51,368 |
| B2030 | Exterior Doors | \$2.01 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$11,031 |
| B3010 | Roof Coverings - Standing Seam Metal | \$11.91 | S.F. | 5,488 | 75 | 1998 | 2073 | | 77.33 % | 6.29 % | 58 | | \$4,110.19 | \$65,362 |
| C1010 | Partitions | \$12.78 | S.F. | 5,488 | 100 | 1998 | 2098 | | 83.00 % | 0.00 % | 83 | | | \$70,137 |
| C1020 | Interior Doors | \$4.24 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$23,269 |
| C1030 | Fittings | \$3.46 | S.F. | 5,488 | 20 | 1998 | 2018 | 2015 | 0.00 % | 110.00 % | 0 | | \$20,887.00 | \$18,988 |
| C3010 | Wall Finishes - Ceramic | \$6.65 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| C3010 | Wall Finishes - Paint | \$1.41 | S.F. | 5,488 | 10 | 1998 | 2008 | | 0.00 % | 110.00 % | -7 | | \$8,512.00 | \$7,738 |
| C3020 | Floor Finishes - Ceramic Tile | \$6.67 | S.F. | 293 | 50 | 1998 | 2048 | | 66.00 % | 0.00 % | 33 | | | \$1,954 |
| C3020 | Floor Finishes - VCT | \$5.01 | S.F. | 470 | 15 | 1998 | 2013 | 2018 | 20.00 % | 0.00 % | 3 | | | \$2,355 |
| C3020 | Floor Finishes - Vinyl Roll | \$18.00 | S.F. | 4,700 | 15 | 1998 | 2013 | 2018 | 20.00 % | 0.00 % | 3 | | | \$84,600 |
| C3030 | Ceiling Finishes | \$4.31 | S.F. | 5,488 | 20 | 1998 | 2018 | | 15.00 % | 29.20 % | 3 | | \$6,906.04 | \$23,653 |
| D2010 | Plumbing Fixtures | \$9.66 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 1.41 % | 13 | | \$749.95 | \$53,014 |
| D2020 | Domestic Water Distribution | \$5.85 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$32,105 |
| D2030 | Sanitary Waste | \$0.87 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$4,775 |
| D2040 | Rain Water Drainage | \$0.22 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| D2090 | Other Plumbing Systems - Natural Gas | \$0.32 | S.F. | 5,488 | 40 | 1998 | 2038 | | 57.50 % | 0.00 % | 23 | | | \$1,756 |
| D3040 | Distribution Systems & Exhaust Systems | \$4.86 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$26,672 |
| D3050 | Terminal & Package Units | \$11.65 | S.F. | 5,488 | 15 | 1998 | 2013 | 2015 | 0.00 % | 110.00 % | 0 | | \$70,329.00 | \$63,935 |
| D3060 | Controls & Instrumentation | \$0.26 | S.F. | 5,488 | 20 | 1998 | 2018 | | 15.00 % | 0.00 % | 3 | | | \$1,427 |
| D4010 | Sprinklers | \$3.84 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| D4090 | Other Fire Protection Systems | \$0.15 | S.F. | 5,488 | 10 | | | 2015 | 0.00 % | 110.09 % | 0 | | \$906.00 | \$823 |
| D5010 | Electrical Service/Distribution | \$1.24 | S.F. | 5,488 | 40 | 1998 | 2038 | | 57.50 % | 0.00 % | 23 | | | \$6,805 |
| D5020 | Branch Wiring | \$5.24 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$28,757 |
| D5020 | Lighting | \$5.24 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 2.93 % | 13 | | \$841.58 | \$28,757 |
| D5030 | Communications and Security - Fire Alarm | \$2.13 | S.F. | 5,488 | 15 | 1998 | 2013 | | 0.00 % | 110.00 % | -2 | | \$12,858.00 | \$11,689 |
| D5030 | Communications and Security - Public Address & Clock System | \$0.88 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| D5030 | Communications and Security - Security & CCTV | \$0.88 | S.F. | 5,488 | 15 | 1998 | 2013 | | 0.00 % | 110.00 % | -2 | | \$5,312.00 | \$4,829 |
| E1090 | Other Equipment - Athletic | \$13.03 | S.F. | 5,488 | 20 | 1998 | 2018 | | 15.00 % | 0.00 % | 3 | | | \$71,509 |
| Total | | | | | | | | | 50.11 % | 13.03 % | | | \$131,411.76 | \$1,008,532 |

Renewal Schedule

eComet forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the system listing. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

Inflation Rate: 3%

| System | Current Deficiencies | 2016 | 2017 | 2018 | 2019 | 2020 | 2021 | 2022 | 2023 | 2024 | 2025 | Total |
|--|----------------------|------------|------------|------------------|------------|------------|------------|------------|------------|------------|-----------------|------------------|
| Total: | \$131,412 | \$0 | \$0 | \$220,620 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$12,657 | \$364,689 |
| * A - Substructure | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| * A10 - Foundations | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| * A1010 - Standard Foundations | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| * A1030 - Slab on Grade | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B - Shell | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B10 - Superstructure | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| * B1020 - Roof Construction | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B20 - Exterior Enclosure | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| * B2010 - Exterior Walls | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B2020 - Exterior Windows | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B2030 - Exterior Doors | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B30 - Roofing | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| B3010 - Roof Coverings - Standing Seam Metal | \$4,110 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$4,110 |
| C - Interiors | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C10 - Interior Construction | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C1010 - Partitions | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C1020 - Interior Doors | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C1030 - Fittings | \$20,887 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$20,887 |
| C30 - Interior Finishes | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C3010 - Wall Finishes - Ceramic | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C3010 - Wall Finishes - Paint | \$8,512 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$11,439 | \$19,951 |
| C3020 - Floor Finishes - Ceramic Tile | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| C3020 - Floor Finishes - VCT | \$0 | \$0 | \$0 | \$2,830 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$2,830 |
| C3020 - Floor Finishes - Vinyl Roll | \$0 | \$0 | \$0 | \$101,689 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$101,689 |
| C3030 - Ceiling Finishes | \$6,906 | \$0 | \$0 | \$28,432 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$35,338 |


School Assessment Report - 1998 Gym

| | | | | | | | | | | | | |
|---|----------|-----|-----|----------|-----|-----|-----|-----|-----|-----|---------|----------|
| D - Services | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D20 - Plumbing | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D2010 - Plumbing Fixtures | \$750 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$750 |
| D2020 - Domestic Water Distribution | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D2030 - Sanitary Waste | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D2040 - Rain Water Drainage | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D2090 - Other Plumbing Systems - Natural Gas | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D30 - HVAC | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D3040 - Distribution Systems & Exhaust Systems | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D3050 - Terminal & Package Units | \$70,329 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$70,329 |
| D3060 - Controls & Instrumentation | \$0 | \$0 | \$0 | \$1,716 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$1,716 |
| D40 - Fire Protection | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D4010 - Sprinklers | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D4090 - Other Fire Protection Systems | \$906 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$1,218 | \$2,124 |
| D50 - Electrical | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D5010 - Electrical Service/Distribution | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D5020 - Branch Wiring | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D5020 - Lighting | \$842 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$842 |
| D5030 - Communications and Security - Fire Alarm | \$12,858 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$12,858 |
| D5030 - Communications and Security - Public Address & Clock System | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| D5030 - Communications and Security - Security & CCTV | \$5,312 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$5,312 |
| E - Equipment & Furnishings | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| E10 - Equipment | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| E1090 - Other Equipment - Athletic | \$0 | \$0 | \$0 | \$85,954 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$85,954 |

* Indicates non-renewable system


Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and the forecasted capital renewal (system replacement) requirements over the next ten years.

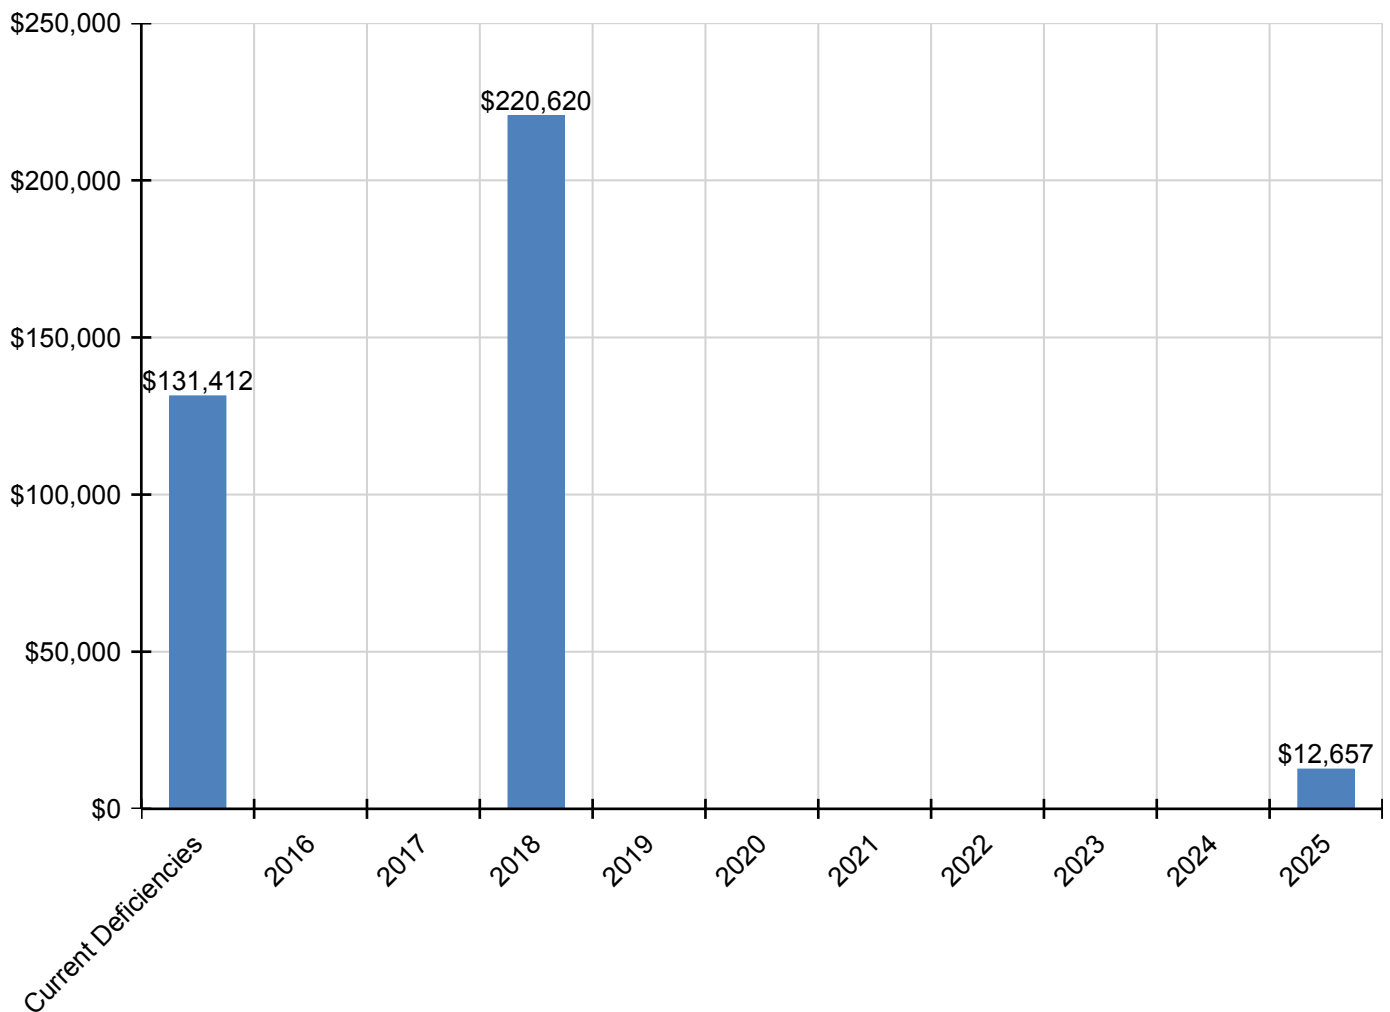

Deficiency Summary by System


Current deficiencies include assemblies that have reached or exceed their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Service Life'. The following chart lists all current deficiencies associated with this facility broken down by UNIFORMAT system.

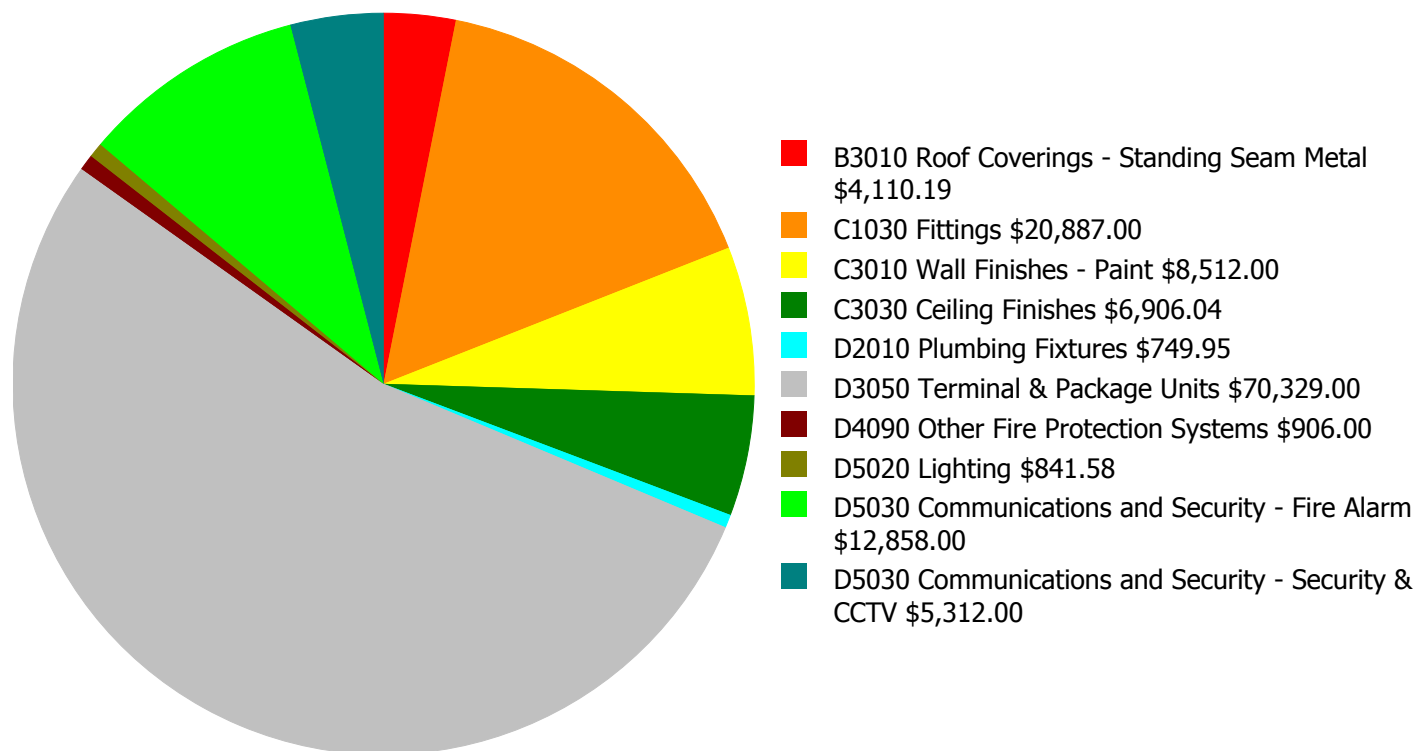

Budget Estimate Total: \$131,411.76

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

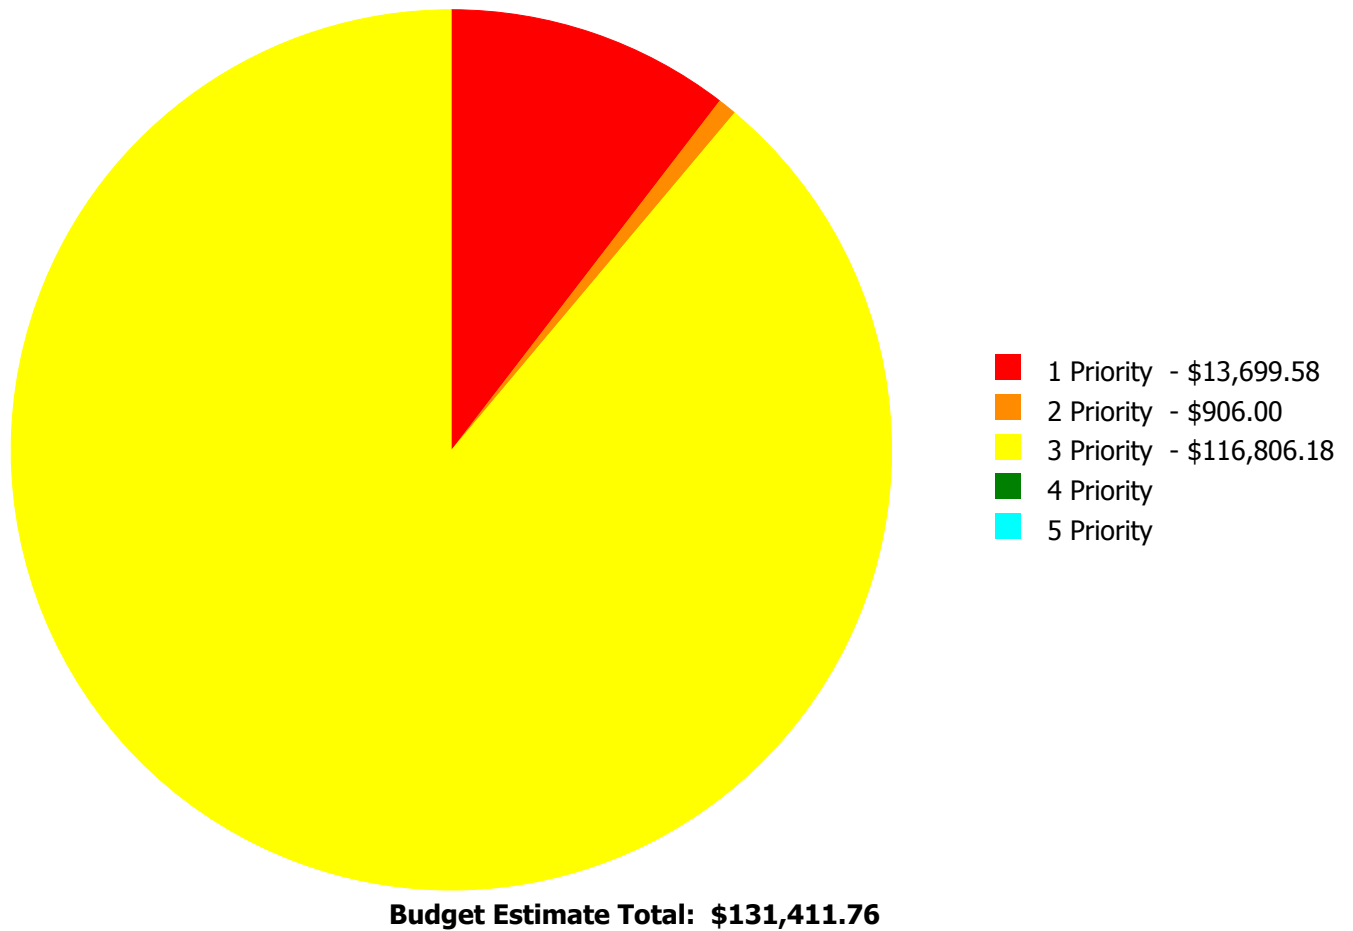

Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

- **Priority 1** deficiencies require immediate review to correct a potential life/safety hazard, stop accelerated deterioration, or return a facility to operation.
- **Priority 2** deficiencies could become a Priority 1 deficiency, if not corrected within the next 2-3 years. These include intermittent operations, rapid deterioration, or potential life/safety hazards. .
- **Priority 3** deficiencies require appropriate attention to preclude predictable deterioration or potential downtime and the associated damage or higher costs if deferred further and not completed within the next 3-5 years.
- **Priority 4** deficiencies represent a sensible improvement to existing conditions. The recommended improvements are not required for the basic functionality of the facility; however addressing these deficiencies will improve overall usability and/or reduce long term maintenance costs. Repairs for these deficiencies may be budgeted and scheduled for completion within the next 5-7 years.
- **Priority 5** deficiencies will include conditions that have no impact on the function or usability of the facility, such as appearance. No action is required for these deficiencies, but they are tracked since they may require future inspection or be completed as part of related repairs in contiguous areas of the facility.

| System Code | System Description | Priority 1 | Priority 2 | Priority 3 | Priority 4 | Priority 5 | Total |
|---------------|---|-------------|------------|--------------|------------|------------|--------------|
| B3010 | Roof Coverings - Standing Seam Metal | \$0.00 | \$0.00 | \$4,110.19 | \$0.00 | \$0.00 | \$4,110.19 |
| C1030 | Fittings | \$0.00 | \$0.00 | \$20,887.00 | \$0.00 | \$0.00 | \$20,887.00 |
| C3010 | Wall Finishes - Paint | \$0.00 | \$0.00 | \$8,512.00 | \$0.00 | \$0.00 | \$8,512.00 |
| C3030 | Ceiling Finishes | \$0.00 | \$0.00 | \$6,906.04 | \$0.00 | \$0.00 | \$6,906.04 |
| D2010 | Plumbing Fixtures | \$0.00 | \$0.00 | \$749.95 | \$0.00 | \$0.00 | \$749.95 |
| D3050 | Terminal & Package Units | \$0.00 | \$0.00 | \$70,329.00 | \$0.00 | \$0.00 | \$70,329.00 |
| D4090 | Other Fire Protection Systems | \$0.00 | \$906.00 | \$0.00 | \$0.00 | \$0.00 | \$906.00 |
| D5020 | Lighting | \$841.58 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$841.58 |
| D5030 | Communications and Security - Fire Alarm | \$12,858.00 | \$0.00 | \$0.00 | \$0.00 | \$0.00 | \$12,858.00 |
| D5030 | Communications and Security - Security & CCTV | \$0.00 | \$0.00 | \$5,312.00 | \$0.00 | \$0.00 | \$5,312.00 |
| Total: | | \$13,699.58 | \$906.00 | \$116,806.18 | \$0.00 | \$0.00 | \$131,411.76 |

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

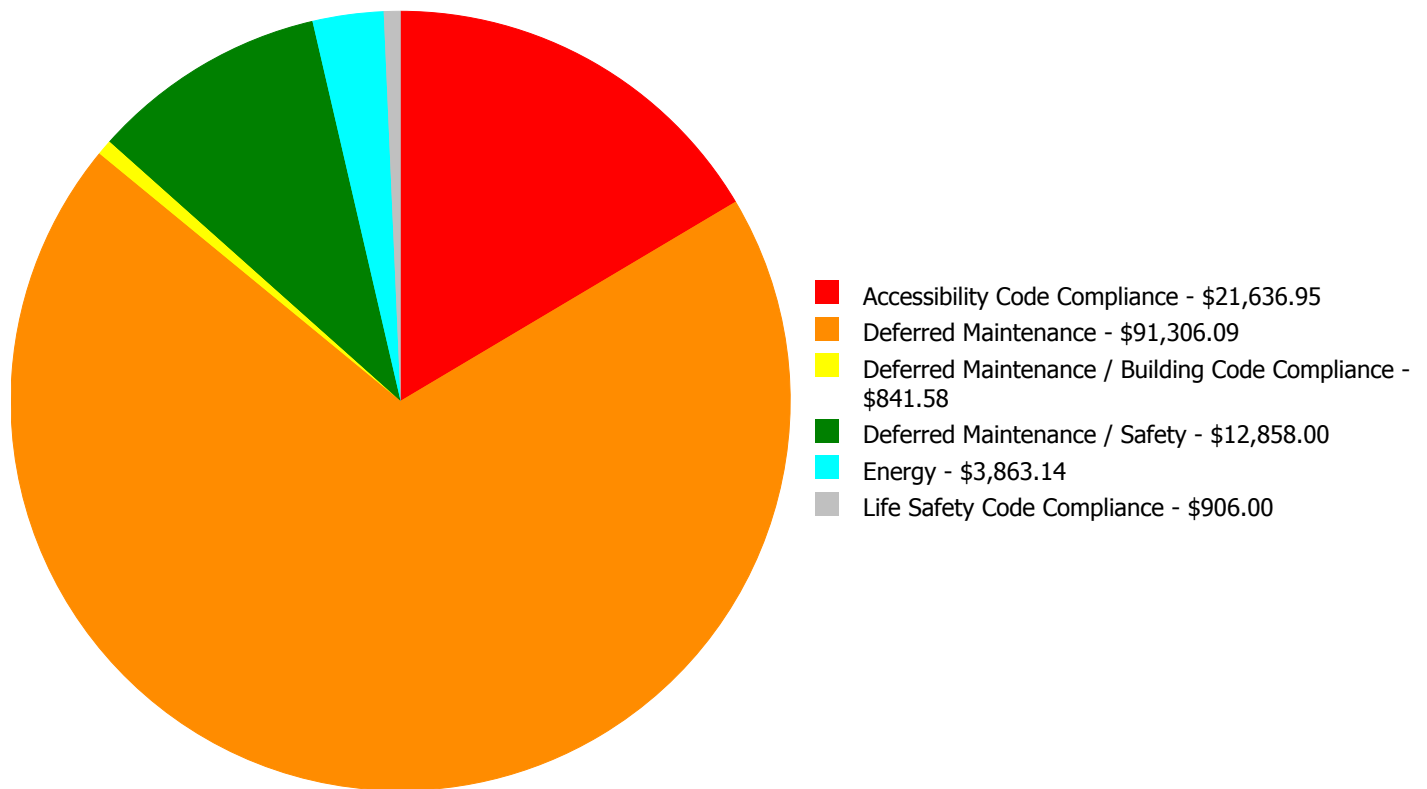

Budget Estimate Total: \$131,411.76

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 1 Priority:

System: D5020 - Lighting



Location: Throughout Building

Distress: Needs Remediation

Category: Deferred Maintenance / Building Code Compliance

Priority: 1 Priority

Correction: Add/replace illuminated exit signage

Qty: 2.00

Unit of Measure: Ea.


Estimate: \$841.58

Assessor Name: Sam Mandola

Date Created: 07/11/2015

Notes: Exit lights are not functioning.

System: D5030 - Communications and Security - Fire Alarm

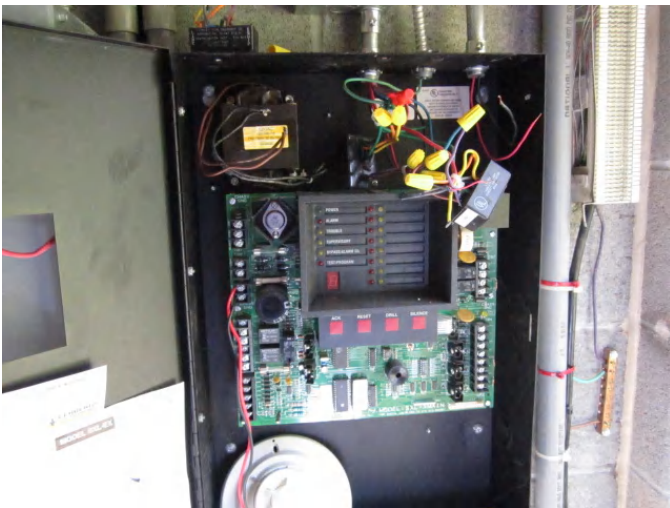

Location: Electrical Room

Distress: Needs Remediation

Category: Deferred Maintenance / Safety

Priority: 1 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$12,858.00

Assessor Name: Ben Nixon

Date Created: 04/27/2015

Notes: The fire alarm system is beyond its expected service life and should be scheduled for replacement. Also, the battery in the fire alarm control panel (FACP) is disconnected so that the system is not operable; urgent to correct.

Priority 2 Priority:

System: D4090 - Other Fire Protection Systems



Location: Throughout Building

Distress: Missing

Category: Life Safety Code Compliance

Priority: 2 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$906.00

Assessor Name: Ben Nixon

Date Created: 09/16/2015

Notes: The gym is currently being occupied and fire extinguishers are missing and should be provided.

Priority 3 Priority:

System: B3010 - Roof Coverings - Standing Seam Metal



Location: Roof

Distress: Inadequate

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Debris removal, by hand and visual inspection, metal panel roofing

Qty: 55.00

Unit of Measure: M.S.F.

Estimate: \$4,110.19

Assessor Name: Sam Mandola

Date Created: 04/27/2015

Notes: Metal roof has debris on it, including the gutters and downspouts, and should be cleaned to prevent damage.

System: C1030 - Fittings



Location: Throughout Building

Distress: Inadequate

Category: Accessibility Code Compliance

Priority: 3 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$20,887.00

Assessor Name: Ben Nixon

Date Created: 04/27/2015

Notes: Fittings, such as toilet partitions and signage, are in marginal condition, missing in some instances, and not ADA compliant, and should be replaced.

System: C3010 - Wall Finishes - Paint



Location: Throughout Building

Distress: Beyond Service Life

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$8,512.00

Assessor Name: Ben Nixon

Date Created: 04/27/2015

Notes: The wall finishes are aged, scuffed, stained, and fading and should be repainted.

System: C3030 - Ceiling Finishes



Location: Ceiling

Distress: Damaged

Category: Energy

Priority: 3 Priority

Correction: Replace Vinyl Backed Fiberglass Insulation Blankets

Qty: 250.00

Unit of Measure: S.F.

Estimate: \$3,863.14

Assessor Name: Sam Mandola

Date Created: 05/15/2015

Notes: The ceiling insulation blanket is damaged in different locations and should be repaired.

System: C3030 - Ceiling Finishes



Location: Office

Distress: Inadequate

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Replace acoustic tile ceiling, non fire-rated

Qty: 10.00

Unit of Measure: C.S.F.

Estimate: \$3,042.90

Assessor Name: Sam Mandola

Date Created: 04/27/2015

Notes: Acoustic ceiling tiles are in deteriorating condition, missing or sagging, and should be replaced.

System: D2010 - Plumbing Fixtures



Location: Restrooms

Distress: Missing

Category: Accessibility Code Compliance

Priority: 3 Priority

Correction: Add ADA compliant insulation to lavatory piping

Qty: 2.00

Unit of Measure: Ea.

Estimate: \$749.95

Assessor Name: Sam Mandola

Date Created: 04/27/2015

Notes: Exposed pipes under sinks are not sufficiently insulated against contact. Add insulation.

System: D3050 - Terminal & Package Units



Location: Throughout Building

Distress: Beyond Service Life

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$70,329.00

Assessor Name: Ben Nixon

Date Created: 04/27/2015

Notes: The system is beyond its expected service life and should be scheduled for replacement. In addition to replacing existing system, add an air conditioning system for the main open area of the gym.

System: D5030 - Communications and Security - Security & CCTV



Location: Throughout Building

Distress: Beyond Service Life

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$5,312.00

Assessor Name: Ben Nixon

Date Created: 04/27/2015

Notes: The system is beyond its expected service life, damaged due to vandalism, and should be scheduled for replacement. One exterior-mounted CCTV camera was painted over. It is not clear to what extent the site security system is functioning.

Executive Summary

Building condition is evaluated based on the functional systems and elements of a building and organized according to the UNIFORMAT II Elemental Classification. The grouping of these systems and elements and applying a current replacement value to them develops a representative building cost model. Cost Models are developed for similar building types and functions. Systems and their elements are evaluated based on their current replacement values, life cycles, installation dates and next renewal dates. Systems and their elements that are within their useful lives are further evaluated to identify current deficient conditions that may have a significant impact on a system's or element's remaining service life, and to determine if they are beyond their predicted expected life. The system's or element's current replacement value is based on RS Means Commercial Cost Data.

Following are the cost model's system details for this facility. The **Replacement Value** is the amount needed to replace the property of the same present scope. The **Repair Cost** (the sum of the cost to repair/replace the Deficiencies) represents the budgeted contractor-installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging of the work. **Facility Condition Index (FCI)** is an industry-standard measurement of facility condition calculated as the ratio of the costs to correct a facility's deficiencies (Condition Needs) to the facility's Current Replacement Value. It ranges from 0% (new) to 100% (very poor - beyond service life). The **Remaining Service Life Index (RSLI)** is calculated as the sum of a renewable system's **Remaining Service Life (RSL)** divided by the sum of a system's Replacement Value (both values exclude soft-cost to simplify calculation updates) expressed as a percentage ranging from 100% (new) to 0% (expired). The relationship between the key metrics FCI and RSLI is an important indicator, at either the facility, building, system, or component levels, of the condition trend and the imminent need for capital renewal. These indices exist in an inverse relationship wherein the FCI increases when systems reach their expected life-cycle age, whereas the RSLI decreases annually indicating the relative time remaining before reaching the life-cycle expiration age. For example, a facility or a system with a high RSLI and a low FCI indicates it is in the early portion of its useful life. However, a low RSLI indicates that expiration dates are approaching at which point the FCI would increase. The term **FCA Score** is the inverse of Total FCI and calculated as $100 - \text{Total FCI}$ (without the %) where 100 is best and 0 is worst condition.

| | |
|--------------------|--------------|
| Function: | Vacant |
| Gross Area (SF): | 5,488 |
| Year Built: | 1998 |
| Last Renovation: | |
| Replacement Value: | \$732,669 |
| Repair Cost: | \$221,746.64 |
| Total FCI: | 30.27 % |
| Total RSLI: | 11.55 % |
| FCA Score: | 69.73 |



Description:

The Former Shallowford Elementary School site was originally constructed in 1968, has a total area of 9.1 acres, and is occupied by approximately 5,488 square feet of gymnasium building space. The site contains remnants of concrete and asphalt-paved roads and parking, concrete sidewalks, and metal fencing, and severely overgrown landscaping. This report contains condition and adequacy data collected during the 2015 Facility Condition Assessment (FCA). Detailed condition and deficiency statements are contained in this report for the site features.

Attributes:

General Attributes:

Site Code: 1605

Condition Summary

The Table below shows the RSLI and FCI for each major building system shown at the UNIFORMAT classification Level II. Note that Systems with lower FCIs require less investment than systems with higher FCIs.

| UNIFORMAT Classification | RSLI % | FCI % | Current Repair Cost |
|---------------------------------|----------------|----------------|---------------------|
| G20 - Site Improvements | 11.69 % | 32.43 % | \$218,069.68 |
| G30 - Site Mechanical Utilities | 6.69 % | 0.00 % | \$0.00 |
| G40 - Site Electrical Utilities | 16.57 % | 18.21 % | \$3,676.96 |
| Totals: | 11.55 % | 30.27 % | \$221,746.64 |

Photo Album

The photo album consists of the various cardinal directions of the building.

1). Aerial Image of Former Shallowford Elementary School - Jul 07, 2015



2). Covered Walkway - Jul 07, 2015



Condition Detail

This section of the report contains results of the Facility Condition Assessment. The building is separated into system components based on UNIFORMAT II. The columns in the System Listing table represent the following:

1. System Code: A code that identifies the system.
2. System Description: A brief description of a system present in the building.
3. Unit Price \$: The unit price of the system.
4. UoM: The unit of measure of the system.
5. Qty: The quantity for the system.
6. Life: Building Owners and Managers Association (BOMA) recommended system design life.
7. Year Installed: The date of system installation.
8. Calc Next Renewal Year: The date of system expiration based on the life, NR stands for non renewable.
9. Next Renewal Year: The suggested system expiration date by the assessor based on visual inspection.
10. RSLI: The Remaining Service Life Index of the system.
11. FCI: The Facility Condition Index of the system.
12. RSL: Remaining Service Life in years.
13. eCR: eCOMET Condition Rating (not used in this assessment).
14. Deficiency \$: The financial investment to repair/replace system to address deficiency.
15. Replacement Value \$: The replacement cost of the system.

System Listing

The System Listing table below lists each of the systems organized by their UNIFORMAT II classification. The assessment team was tasked with recording the most recent replacement year of each system, determining the remaining service life based on the theoretical life, and evaluating the condition to confirm the forecast next replacement year. The system listing is the basis for all data contained in the Building Assessment Report.

| System Code | System Description | Unit Price \$ | UoM | Qty | Life | Year Installed | Calc Next Renewal Year | Next Renewal Year | RSLI% | FCI% | RSL | eCR | Deficiency \$ | Replacement Value \$ |
|--------------|--------------------------------|---------------|------|---------|------|----------------|------------------------|-------------------|----------------|----------------|-----|-----|---------------------|----------------------|
| G2010 | Roadways | \$5.17 | S.F. | 25,727 | 25 | 1968 | 1993 | | 0.00 % | 110.00 % | -22 | | \$146,309.45 | \$133,009 |
| G2020 | Parking Lots | \$4.56 | S.F. | 9,225 | 25 | 1968 | 1993 | | 0.00 % | 110.00 % | -22 | | \$46,272.60 | \$42,066 |
| G2030 | Pedestrian Paving | \$1.50 | S.F. | 5,488 | 30 | 1998 | 2028 | 2015 | 0.00 % | 110.00 % | 0 | | \$9,055.20 | \$8,232 |
| G2040 | Baseball Field | \$8.35 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Canopies | \$0.29 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Covered Walkways | \$48.72 | S.F. | 675 | 25 | 1998 | 2023 | | 32.00 % | 0.00 % | 8 | | | \$32,886 |
| G2040 | Fencing & Guardrails | \$0.91 | S.F. | 5,488 | 25 | 1998 | 2023 | | 32.00 % | 153.77 % | 8 | | \$7,679.07 | \$4,994 |
| G2040 | Football Field | \$5.85 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Hard Surface Play Area | \$6.26 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Playing Field | \$3.92 | S.F. | 113,064 | 20 | 1998 | 2018 | | 15.00 % | 0.00 % | 3 | | | \$443,211 |
| G2040 | Soccer/Lacross Field | \$5.00 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Softball Field | \$8.86 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Tennis Courts | \$18.47 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2040 | Track | \$7.04 | S.F. | | 0 | | | | 0.00 % | 0.00 % | | | | \$0 |
| G2050 | Landscaping | \$1.45 | S.F. | 5,488 | 15 | 1998 | 2013 | | 0.00 % | 109.99 % | -2 | | \$8,753.36 | \$7,958 |
| G3010 | Water Supply | \$1.83 | S.F. | 5,488 | 50 | 1968 | 2018 | | 6.00 % | 0.00 % | 3 | | | \$10,043 |
| G3020 | Sanitary Sewer | \$1.15 | S.F. | 5,488 | 50 | 1968 | 2018 | | 6.00 % | 0.00 % | 3 | | | \$6,311 |
| G3030 | Storm Sewer | \$3.55 | S.F. | 5,488 | 50 | 1968 | 2018 | | 6.00 % | 0.00 % | 3 | | | \$19,482 |
| G3060 | Fuel Distribution | \$0.78 | S.F. | 5,488 | 40 | 1968 | 2008 | 2020 | 12.50 % | 0.00 % | 5 | | | \$4,281 |
| G4010 | Electrical Distribution | \$1.86 | S.F. | 5,488 | 50 | 1968 | 2018 | | 6.00 % | 0.00 % | 3 | | | \$10,208 |
| G4020 | Site Lighting | \$1.15 | S.F. | 5,488 | 30 | 1998 | 2028 | | 43.33 % | 0.00 % | 13 | | | \$6,311 |
| G4030 | Site Communications & Security | \$0.67 | S.F. | 5,488 | 10 | 1998 | 2008 | | 0.00 % | 100.00 % | -7 | | \$3,676.96 | \$3,677 |
| Total | | | | | | | | | 11.55 % | 30.27 % | | | \$221,746.64 | \$732,669 |

Renewal Schedule

eComet forecasts future Capital Renewal projects for expiring systems based on the Calculated Next Renewal year found in the system listing. There is a 3% yearly inflation factor applied to the system costs expiring in the future. The table below reflects Capital Renewal projects over the next 10 years. Note: Blank cells (or \$0) indicate no systems are scheduled for renewal in that year.

School Assessment Report - Site


Inflation Rate: 3%

| System | Current Deficiencies | 2016 | 2017 | 2018 | 2019 | 2020 | 2021 | 2022 | 2023 | 2024 | 2025 | Total |
|--|----------------------|------------|------------|------------------|------------|----------------|------------|------------|-----------------|------------|----------------|------------------|
| Total: | \$221,747 | \$0 | \$0 | \$588,084 | \$0 | \$5,459 | \$0 | \$0 | \$52,784 | \$0 | \$4,942 | \$873,015 |
| G - Building Sitework | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G20 - Site Improvements | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2010 - Roadways | \$146,309 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$146,309 |
| G2020 - Parking Lots | \$46,273 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$46,273 |
| G2030 - Pedestrian Paving | \$9,055 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$9,055 |
| G2040 - Baseball Field | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Canopies | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Covered Walkways | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$45,825 | \$0 | \$0 | \$45,825 |
| G2040 - Fencing & Guardrails | \$7,679 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$6,958 | \$0 | \$0 | \$14,637 |
| G2040 - Football Field | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Hard Surface Play Area | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Playing Field | \$0 | \$0 | \$0 | \$532,739 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$532,739 |
| G2040 - Soccer/Lacross Field | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Softball Field | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Tennis Courts | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2040 - Track | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G2050 - Landscaping | \$8,753 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$8,753 |
| G30 - Site Mechanical Utilities | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G3010 - Water Supply | \$0 | \$0 | \$0 | \$12,071 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$12,071 |
| G3020 - Sanitary Sewer | \$0 | \$0 | \$0 | \$7,586 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$7,586 |
| G3030 - Storm Sewer | \$0 | \$0 | \$0 | \$23,418 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$23,418 |
| G3060 - Fuel Distribution | \$0 | \$0 | \$0 | \$0 | \$0 | \$5,459 | \$0 | \$0 | \$0 | \$0 | \$0 | \$5,459 |
| G40 - Site Electrical Utilities | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G4010 - Electrical Distribution | \$0 | \$0 | \$0 | \$12,269 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$12,269 |
| G4020 - Site Lighting | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 |
| G4030 - Site Communications & Security | \$3,677 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$0 | \$4,942 | \$8,619 |

* Indicates non-renewable system


Forecasted Capital Renewal Requirement

The following chart shows the current building deficiencies and the forecasted capital renewal (system replacement) requirements over the next ten years.

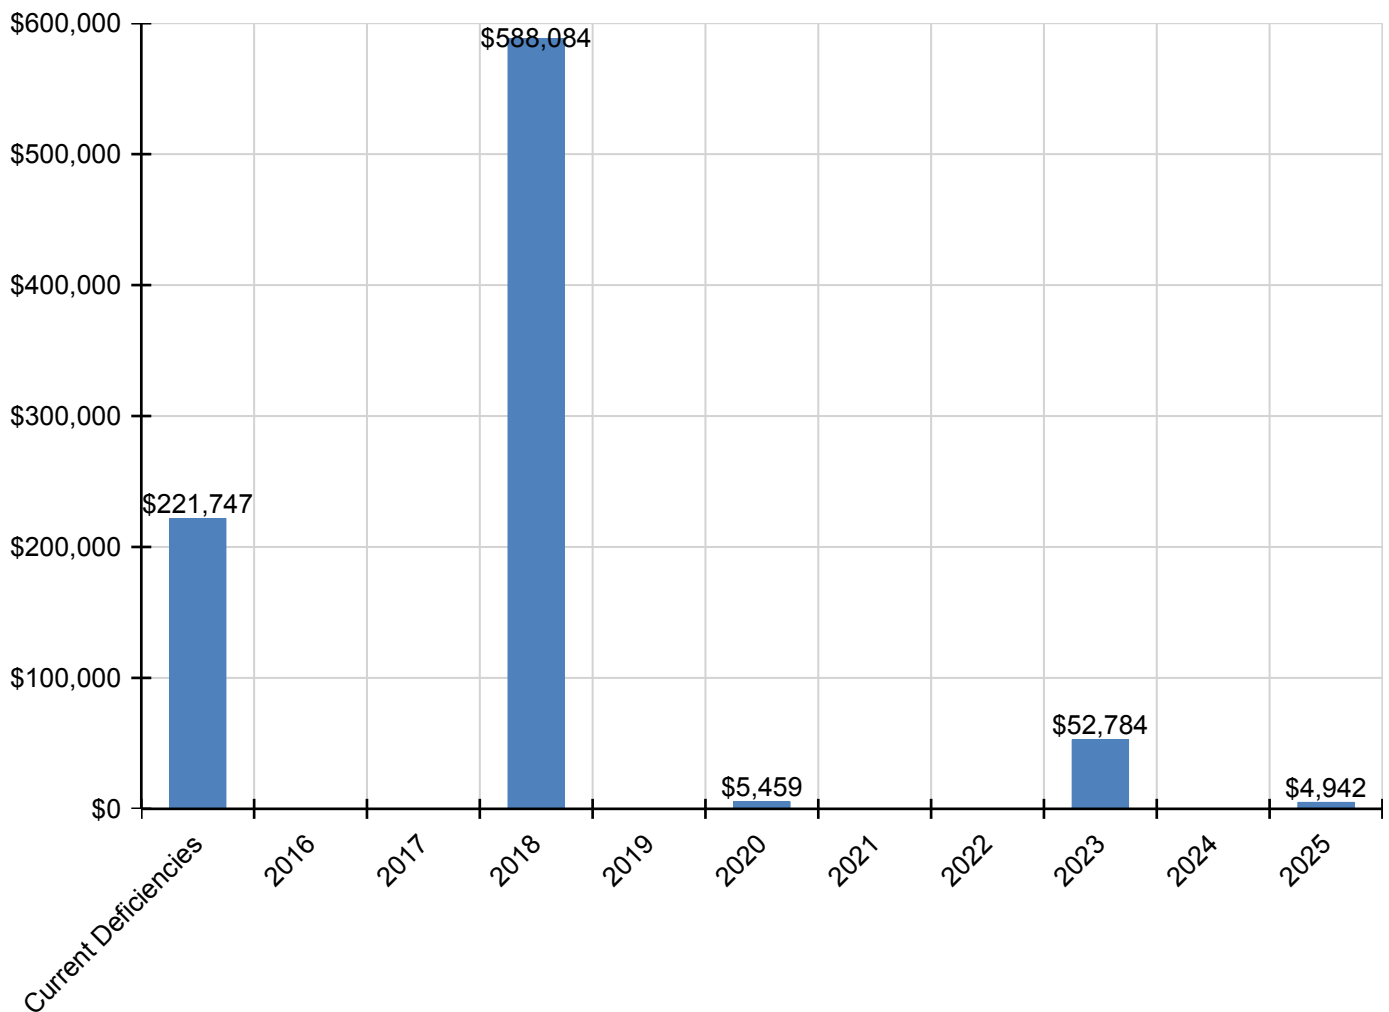

Deficiency Summary by System


Current deficiencies include assemblies that have reached or exceed their design life or components of the assemblies that are in need of repair. Assemblies that have reached their design life are identified as current deficiencies and assigned the distress 'Beyond Service Life'. The following chart lists all current deficiencies associated with this facility broken down by UNIFORMAT system.

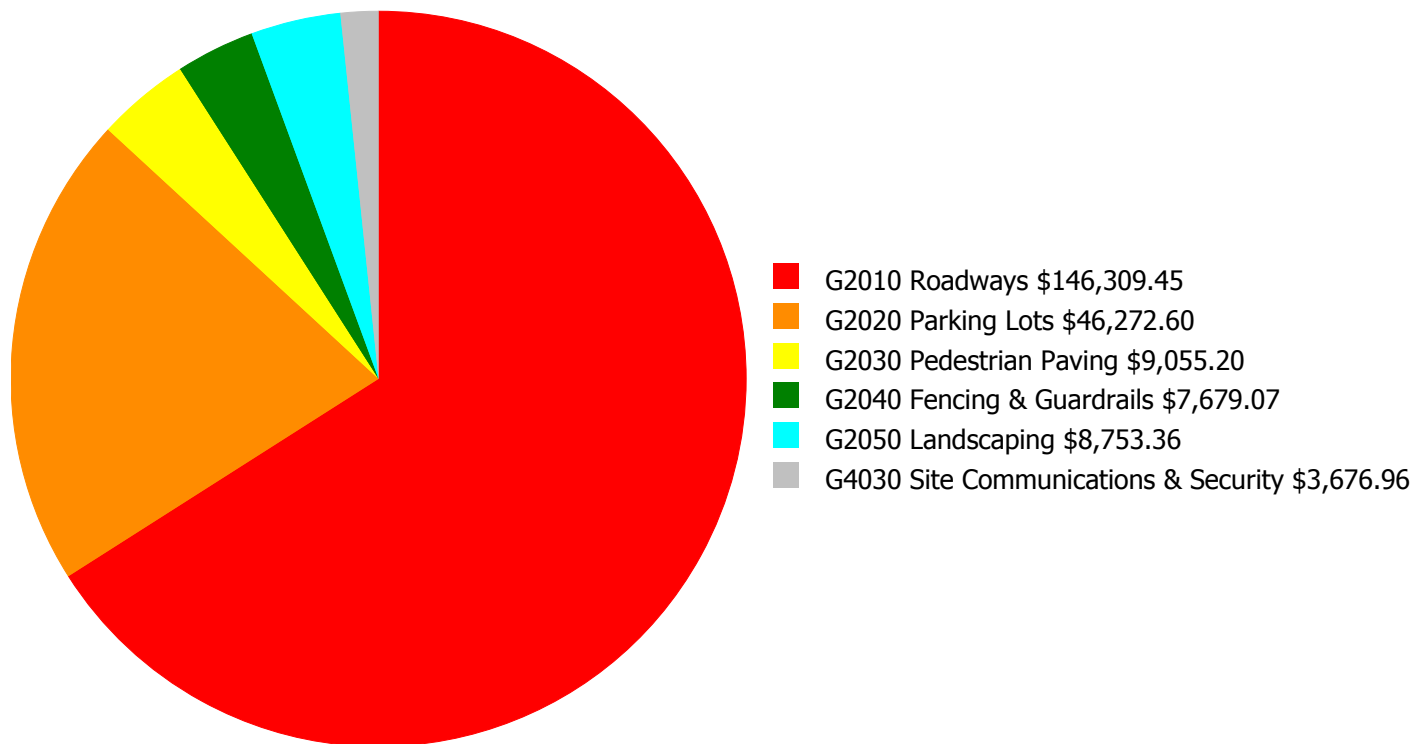

Budget Estimate Total: \$221,746.64

Deficiency Summary by Priority

The following chart shows the total repair costs broken down by priority. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

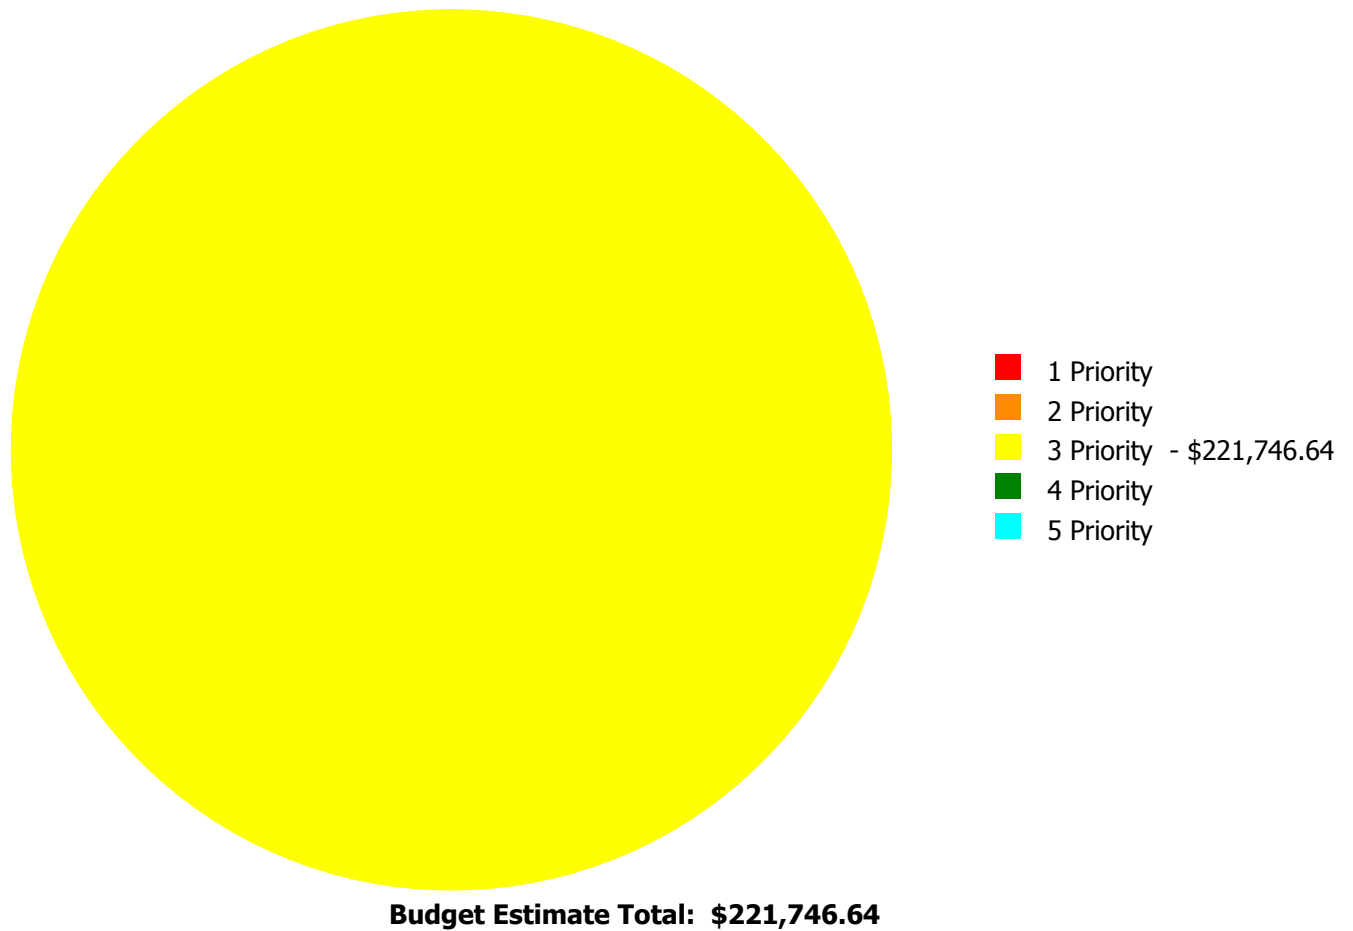

Deficiency By Priority Investment Table


The table below shows the current investment cost grouped by deficiency priority and building system. Assessors assigned deficiencies within eCOMET to one of the following priority categories:

- **Priority 1** deficiencies require immediate review to correct a potential life/safety hazard, stop accelerated deterioration, or return a facility to operation.
- **Priority 2** deficiencies could become a Priority 1 deficiency, if not corrected within the next 2-3 years. These include intermittent operations, rapid deterioration, or potential life/safety hazards.
- **Priority 3** deficiencies require appropriate attention to preclude predictable deterioration or potential downtime and the associated damage or higher costs if deferred further and not completed within the next 3-5 years.
- **Priority 4** deficiencies represent a sensible improvement to existing conditions. The recommended improvements are not required for the basic functionality of the facility; however addressing these deficiencies will improve overall usability and/or reduce long term maintenance costs. Repairs for these deficiencies may be budgeted and scheduled for completion within the next 5-7 years.
- **Priority 5** deficiencies will include conditions that have no impact on the function or usability of the facility, such as appearance. No action is required for these deficiencies, but they are tracked since they may require future inspection or be completed as part of related repairs in contiguous areas of the facility.

| System Code | System Description | Priority 1 | Priority 2 | Priority 3 | Priority 4 | Priority 5 | Total |
|---------------|--------------------------------|------------|------------|--------------|------------|------------|--------------|
| G2010 | Roadways | \$0.00 | \$0.00 | \$146,309.45 | \$0.00 | \$0.00 | \$146,309.45 |
| G2020 | Parking Lots | \$0.00 | \$0.00 | \$46,272.60 | \$0.00 | \$0.00 | \$46,272.60 |
| G2030 | Pedestrian Paving | \$0.00 | \$0.00 | \$9,055.20 | \$0.00 | \$0.00 | \$9,055.20 |
| G2040 | Fencing & Guardrails | \$0.00 | \$0.00 | \$7,679.07 | \$0.00 | \$0.00 | \$7,679.07 |
| G2050 | Landscaping | \$0.00 | \$0.00 | \$8,753.36 | \$0.00 | \$0.00 | \$8,753.36 |
| G4030 | Site Communications & Security | \$0.00 | \$0.00 | \$3,676.96 | \$0.00 | \$0.00 | \$3,676.96 |
| Total: | | \$0.00 | \$0.00 | \$221,746.64 | \$0.00 | \$0.00 | \$221,746.64 |

Deficiency Summary by Category

The following chart shows the total repair costs broken down by deficiency categories. Assessors assigned deficiencies to one of the following categories:

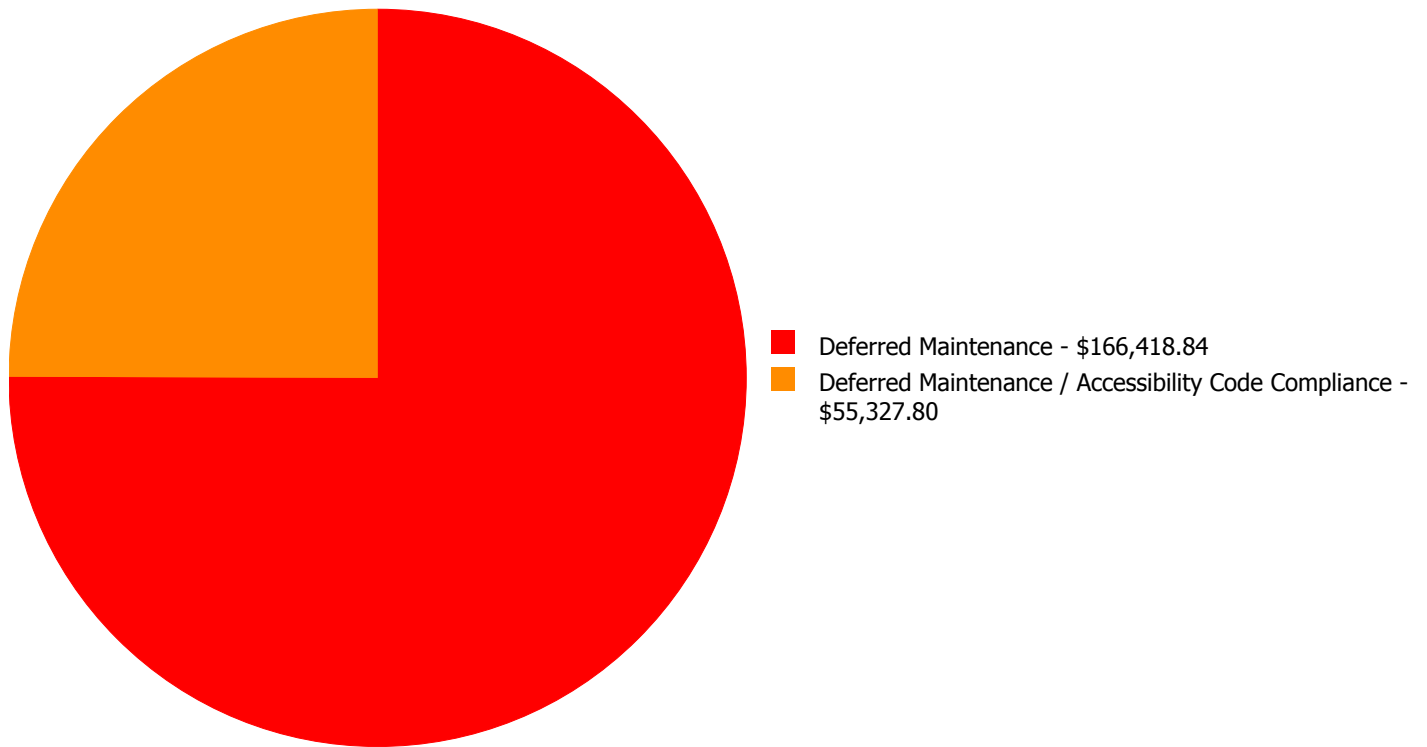

Budget Estimate Total: \$221,746.64

Deficiency Details by Priority

The deficiency detail notes listed below provide additional information on identified deficiencies found within the facility.

Priority 3 Priority:

System: G2010 - Roadways



Location: Site

Distress: Beyond Service Life

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Renew System

Qty: 25,727.00

Unit of Measure: S.F.

Estimate: \$146,309.45

Assessor Name: Eduardo Lopez

Date Created: 04/27/2015

Notes: The roadways are beyond service life, damaged, and should be replaced.

System: G2020 - Parking Lots



Location: Site

Distress: Beyond Service Life

Category: Deferred Maintenance / Accessibility Code Compliance

Priority: 3 Priority

Correction: Renew System

Qty: 9,225.00

Unit of Measure: S.F.

Estimate: \$46,272.60

Assessor Name: Eduardo Lopez

Date Created: 04/27/2015

Notes: The parking lot is beyond its expected service life, damaged with many cracks, not ADA compliant, and should be re-surfaced and restriped.

System: G2030 - Pedestrian Paving



Location: Site

Distress: Beyond Service Life

Category: Deferred Maintenance / Accessibility Code Compliance

Priority: 3 Priority

Correction: Renew System

Qty: 5,488.00

Unit of Measure: S.F.

Estimate: \$9,055.20

Assessor Name: Eduardo Lopez

Date Created: 05/12/2015

Notes: Pedestrian paving is beyond its expected service life, damaged, and not ADA compliant, and should be replaced.

System: G2040 - Fencing & Guardrails



Location: Behind Building

Distress: Damaged

Category: Deferred Maintenance

Priority: 3 Priority

Correction: Remove/replace chain link fencing

Qty: 150.00

Unit of Measure: L.F.

Estimate: \$7,679.07

Assessor Name: Eduardo Lopez

Date Created: 05/18/2015

Notes: The fence is damaged and should be repaired.

System: G2050 - Landscaping



Location: Site
Distress: Beyond Service Life
Category: Deferred Maintenance
Priority: 3 Priority
Correction: Renew System
Qty: 5,488.00
Unit of Measure: S.F.
Estimate: \$8,753.36
Assessor Name: Eduardo Lopez
Date Created: 04/27/2015

Notes: Landscaping is severely overgrown in different areas, has significant areas of soil erosion, and should be improved/maintained.

System: G4030 - Site Communications & Security



Location: Site
Distress: Beyond Service Life
Category: Deferred Maintenance
Priority: 3 Priority
Correction: Renew System
Qty: 5,488.00
Unit of Measure: S.F.
Estimate: \$3,676.96
Assessor Name: Eduardo Lopez
Date Created: 08/13/2015

Notes: Site communications and security systems are beyond their expected service life, vandalized, and should be scheduled for replacement.

Glossary

| | |
|-------------------------|--|
| Abandoned | A facility owned by a district that is not occupied and not maintained. See Vacant. |
| Additional Cost | Total project cost is composed of hard and soft costs. Additional costs or soft expenses are costs that are necessary to accomplish the corrective work but are not directly attributable to the deficient systems direct construction cost, which are often referred to as hard cost. The components included in the soft costs vary by owner but usually include architect and contractor fees, contingencies and other owner-incurred costs necessary to fully develop and build a facility. These soft cost factors can be adjusted anytime within the eCOMET® database at the owner's discretion. |
| Assessment | Visual survey of a facility to determine its condition. It involves looking at the age of systems, reviewing information from local sources and visual evidence of potential problems to assign a condition rating. It does not include destructive testing of materials or testing of systems or equipment for functionality. |
| ASTM | ASTM International (ASTM): Originally known as the American Society for Testing and Materials, ASTM is an international standards organization that develops and publishes voluntary consensus technical standards for a wide range of materials, products, systems, and services. |
| BOMA | Building Owners Managers of America (BOMA): National organization of public and private facility owners focused on building management tools and maintenance techniques. eCOMET® reference: Building and component system effective economic life expectancies. |
| Building | A fully enclosed and roofed structure that can be traversed internally without exiting to the exterior. |
| Building Addition | An area, space or component of a building added to a building after the original building's year built date. NOTE: As a convention in the database, "Main" was used to designate the original building. Additions built prior to 1983 (30 years) were included in the main building area calculations to reflect their predicted system depreciation characteristics and remaining service life. |
| Building Systems | eCOMET® uses UNIFORMAT II to organize building data. UNIFORMAT II was originally developed by the federal General Services Administration to delineate building costs by systems rather than by material. UNIFORMAT II was formalized by an NIST standard, NISTIR 6389 in 1999. It has been further quantified and updated by ASTM standard 2005, E1557-05. The Construction Specifications Institute, CSI, has taken over the standard as part of their MasterFormat / MasterSpec system. |
| Calculated Next Renewal | The year a system or building element would be expected to expire based solely on the date it was installed and the expected useful lifetime for that kind of system. |
| Capital Renewal | Capital renewal refers to the cyclical replacement of building systems or elements as they become obsolete or beyond their useful life. It is not normally included in an annual operating/maintenance budget. See calculated next renewal and next renewal. |
| City Cost Index (CCI) | RS Means provides building system, equipment, and construction costs at a national level. The City Cost Index (also provided by RS Means) localizes those costs to a geographic region of the United States. In eCOMET®, each building or site is assigned a City Cost Index, which adjusts all of the associated costs for systems, deficiencies and inventory to the local value. |
| Condition | Condition refers to the state of physical fitness or readiness of a facility system or system element for its intended use. |
| Condition Budget | The Condition Budget, also known as Condition Needs, represents the budgeted contractor installed costs plus owner's soft costs for the repair, replacement or renewal for a component or system level deficiency. It excludes contributing costs for other components or systems that might also be associated with the corrective actions due to packaging the work. |

School Assessment Report - Former Shallowford Elementary

| | |
|---------------------------------------|--|
| Condition Index (CI) % | The Condition Index (CI) also known as the Remaining Service Life Index (RSLI) is calculated as the sum of a renewable system's Remaining Service Life (RSL) Value divided by the sum of a system's Replacement Value (both values exclude soft cost to simplify calculation updates) expressed as a percentage ranging from 100.00% (new) to 0.00% (expired - no remaining life). |
| Construction Specifications Institute | Construction Specifications Institute: Primary national organization specializing in construction materials data and data location in construction documents. eCOMET® reference: UNIFORMAT II materials classification. |
| Correction | Correction refers to an assessor's recommended deficiency repair or replacement action. For any system or element deficiency, there can be multiple and alternative solutions for its repair or replacement. A Correction is user defined and tied to a UNIFORMAT II element, or system it is intended to address. It excludes other peripheral costs that may also be included in the packaging of repair, replacement or renewal improvements that may also be triggered by the deficiency correction. |
| Cost Model | A cost model is a list of facility systems which could represent the installed systems a given facility. Included in the cost model are standard unit cost estimates, gross areas, life cycles and installed dates. Also represented is the repair cost for deficient systems, replacement values. See eCOMET® cost models. |
| Criteria | Criteria refer to the set of requirements, guidelines or standards that are assessed and rated to develop a score. |
| Current Period | The Current Period is the current year plus a user defined number of forward years. |
| Current Replacement Value (CRV) | The Current Replacement Value (CRV) of a facility, building or system represents the hypothetical cost of rebuilding or replacing an existing facility under today's codes and construction standards, using its current configuration. It is calculated by multiplying the gross area of the facility by a square foot cost developed in that facility's cost model. Replacement cost includes construction costs and owner's additional or soft costs for fees, permits and other expenses to reflect a total project cost. |
| Deferred Maintenance | Deferred maintenance is condition work deferred on a planned or unplanned basis to a future budget cycle or postponed until funds are available. |
| Deficiency | A deficiency is a repair item that is damaged, missing, inadequate or insufficient for an intended purpose. |
| Deficiency Category | Deficiency Category refers to the type or class of a user defined deficiency grouping with shared or similar characteristics. Category descriptions include, but are not limited to: Accessibility Code Compliance, Appearance, Building Code Compliance, Deferred Maintenance, Energy, Environmental, Life Safety Code Compliance, and Safety. |
| Deficiency Distress | Deficiency Distress refers to a user-defined root cause of a deficiency. Distress descriptions are: Beyond Service Life, Damaged, Inadequate, Needs Remediation, and Missing. |
| Deficiency Priority | Deficiency Priority refers to a deficiency's urgency for repair as determined by the assessment team. Deficiencies were assigned a priority of 1 through 5, with Priority 1 deficiencies being the most urgent. |
| eCOMET® | Energy and Condition Management Estimation Technology (eCOMET®) is Parsons proprietary facility asset management software developed to provide facility managers with a state of the art, web-based tool to develop and maintain a comprehensive database of FCA data and information used for facility asset management, maintenance and repair, and capital renewal planning. eCOMET® is used by Parsons and its clients as the primary tool for collecting FCA data, preparing cost estimates, generating individual facility reports and cost estimates, and developing the overall capital renewal program. |

School Assessment Report - Former Shallowford Elementary

| | |
|-------------------------------------|--|
| eCOMET® Cost Models | eCOMET® cost models are derived from RS Means Square Foot Cost Data cost models and these models are used to develop the current replacement value (CRV) and assign life cycle costs to the various systems within a building. Cost models are assigned current costs-per-square-foot to establish replacement values. The Cost models are designed to represent a client specific facility that meets local standards cost trends. |
| Element | Elements are the major components that comprise building systems as defined by UNIFORMAT II. |
| Expected Life | Also referred to as Useful Life. See Useful Life definition. |
| Facility | A facility refers to site(s), building(s), or building addition(s), or combinations thereof that provide a particular service or support of an educational purpose. |
| Facility Attributes | Customizable eCOMET® fields to identify attributes specific to a facility. These fields are part of the eCOMET® database set-up with the owner. |
| Facility Condition Assessment (FCA) | A facility condition assessment (FCA) is a visual inspection of buildings and grounds at a facility to identify and estimate current and future needed repairs or replacements of major systems for planning and budgeting purposes. It is typically performed for organizations that are tasked with the day to day maintenance, operation, and capital renewal (replacement) of building systems and components of a large inventory of facilities. The primary goal of an FCA is to objectively and quantifiably identify, inspect, and prioritize the repair and replacement needs of the building and ground systems (e.g., roofs, windows, doors, floor finishes, plumbing fixtures, parking lot, and sidewalks) within facilities that have either failed or have surpassed their service life, and to identify and forecast future capital replacement needs for systems that have not yet failed, but planned replacement of those systems is needed to ensure that the facilities will continue to meet the mission of the organization. |
| Facility Condition Index (FCI) | FCI is an industry-standard measurement of a facility's condition expressed as a percentage from 0.00% to 100.00% that is derived by dividing the cost to correct a facility's deficiencies by its Current Replacement Value (CRV). The higher the FCI the poorer the condition of a facility. After an FCI is established for all buildings within a portfolio, a building's condition can be ranked relative to other buildings. The FCI may also represent the condition of a portfolio based on the cumulative FCIs of the portfolio's facilities. |
| Forecast Period | The Forecast Period refers to a user defined number of years forward of the Current Period. |
| Gen (Generate) | The Cost Model has a Gen box for each system line item. By checking the box, eCOMET® will generate life cycle deficiencies based on the Year Installed and the Life for that system. Systems that typically do not re-generate (foundations, floor construction, roof construction, basement walls, etc.) would not have the Gen box checked as those systems would not re-generate at the end of a life cycle. In those instances, it would be more practical and cost effective to demolish the entire facility than renew those systems. |
| Gross Square Feet (GSF) | The area of the enclosed floor space of a building or building addition in square feet measured to the outside face of the enclosing wall. |
| Life cycle | Life cycle refers to the period of time that a building or site system or element can be expected to adequately serve its intended function. Parsons assigns expected life cycles to all building systems based on Building Operators and Managers of America (BOMA) recommended life cycles, manufacturers suggested life, and RS Means cost data, and client-provided historical data. BOMA standards are a nationally recognized source of life cycle data for various components and/or systems associated with facilities. RS Means is a national company specializing in construction estimating and costs. |
| Next Renewal | Next Renewal refers to a manually-adjusted expected useful life of a system or element based on on-site inspection either by reducing or extending the Calculated Next Renewal to more accurately reflect current conditions. |

School Assessment Report - Former Shallowford Elementary

| | |
|------------------------------|---|
| Order of Magnitude | Order of Magnitude refers to a rough approximation made with a degree of knowledge and confidence that the budgeted, projected or estimated cost falls within a reasonable range of cost values. |
| Remaining Service Life (RSL) | RSL is the number of years of service remaining for a system or equipment item. It is automatically calculated based on the difference between the current year and the Calculated Next Renewal date or the Next Renewal date whichever one is the later date. |
| Renewal Factors | Renewal factors represent the difference in cost of renovating or replacing an existing system, rather than new construction of a building system. For example, installing a new built-up roof on an existing building would include removing and disposing of the old roof, a cost not associated with new construction. Using a renewal premium to account for demolition and other difficulty costs, Parsons typically assigns a renewal factor of 110%. |
| Renewal Schedule | A timeline by year that indicates when the systems will need to be renewed and the estimated price of the renewal. |
| Repair Cost | Repair cost is the sum of all the deficiencies associated with a building or multiple buildings/facilities. It will include any applied soft costs or City Cost Indexes. |
| Replacement Value | See Current Replacement Value. |
| Site | A facility's grounds and its utilities, roadways, landscaping, fencing and other typical land improvements needed to support a facility. |
| Soft Costs | Soft Costs are a construction industry term that refers to expense items that are not considered direct construction costs. Soft costs are user-defined and include architectural, engineering, management, testing, and mitigation fees, and other owner pre- and post-construction expenses. |
| Sustainability | Sustainability refers to the collection of policies and strategies that meet society's present needs without compromising the ability of future generations to meet their own needs. |
| System | System refers to building and related site work elements as described by ASTM UNIFORMAT II Classification for Building Elements (E1557-97), a format for classifying major facility elements common to most buildings. Elements usually perform a given function regardless of the design specification construction method or materials used. See also UNIFORMAT II. |
| System Generated Deficiency | eCOMET® automatically generates system deficiencies based on system life cycles using the systems installation dates as the base year. By adjusting the Next Renewal date ahead or behind the predicted or stated life cycle date, a system cost will come due earlier or later than the originally installed life cycle date. This utility accounts for good maintenance conditions and a longer life, or early expiration of a system life due to any number of adverse factors such as poor installation, acts of god, material defects, poor design applications and other factors that may shorten the life of a material or system. It is important to mention that the condition of the systems is not necessarily a reflection of maintenance practices, but a combination of system usage and age. |
| UNIFORMAT | ASTM UNIFORMAT II, Classification for Building Elements (E1557-97), a publication of the Construction Specification Institute (CSI), is a format used to classify major facility components common to most buildings. The format is based on functional elements or parts of a facility characterized by their functions without regard to the materials and methods used to accomplish them. These elements are often referred to as systems or assemblies. |
| Unit Price | The Unit Price (Raw) x (100% + the Additional Cost Template percentage). |
| Unit Price (Raw) | The actual \$/sq. ft cost being used for the building and systems. It will include adjustments for the City Cost Index applied to the facility. |

School Assessment Report - Former Shallowford Elementary

| | |
|----------------|---|
| Useful Life | Also known as Expected Life, Useful Life refers to the intrinsic period of time a system or element is expected to perform as intended. Useful life is generally provided by manufacturers of materials, systems and elements through their literature, testing and experience. Useful Lives in the database are derived from the Building Owners and Managers (BOMA) organization's guidelines, RSMeans cost data, and from client- defined historical experience. |
| Vacant | Vacant refers to a facility that is not occupied but is a maintained facility by a district. See Abandoned. |
| Year Built | The year that a building or addition was originally built based on its date of substantial completion or occupancy. |
| Year Installed | The year a system or element was built or the most recent major renovation date where a minimum of 70% of the system's Current Replacement Value (CRV) was replaced. |